

JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 3rd Dec., 2015/12th Agra ὁὁφοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιο	, 1937. óóóóóóóó l English	[No. 36 óóóóóóó l Vernacu-
CONTENTS	Pages	lar pages
PART I-Aô Appointments, promotions, transfers and leave of absence sanctioned by the Governor, Government and the Ministers	338-342	
PART I-Bó Notifications, Communiques and General Orders by the Government and the Ministers	413-422	
PART 11-A6 Appointments, promotions, transfers and leave of absence sanctioned by Heads of Departments	71-72	
PART II- Bó Notifications, Notices and Orders by Heads of Departments, Provincial Heads, Magistrates and other officers competent to issue public notices under any law or rule	445-454	
PART II-Có Notifications, Notices and Orders by Election Commission of India, Chief Electoral Officer, Jammu and Kashmir and other Officers of the Department, Election Petitions and Judgements of Election Tribunal		
PART III- Laws, Regulations and Rules passed thereunder		
PART IV6 Reprints from the Government of India Gazette or Gazettes of others Governments		
PART Vó Information and Statistics (a) Rates and prices in the State (b) Rates and wages (c) Crop Report and Forecasts (d) Whether Observations (e) Vital Statistics		
SUPPLEMENT-AóTrade		
Monthly Imports and Exports from the State		
SUPPLEMENT-B6Police		
SUPPLEMENT-CóAdvertisements	149-154	177-180

Printed at the Ranbir Government Press, Jammu.

PART I-A

Jammu & Kashmir Government-Orders

óóóóóóóó

HIGH COURT OF JAMMU AND KASHMIR AT SRINAGAR.

Notification

No. 400 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Jagdish Lal Sharma S/o Mr. Parma Nand Sharma R/o H. No. 107, Lane No. 10, Greater Kailash, Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-358/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 401 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Firdous Ahmad Rather S/o Mr. Mohd. Ahsan Rather R/o Arin, Bandipora, Id-Gah Mohalla has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 402 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Arihant Gupta S/o Mr. Suman Gupta R/o 521, Sector-7, Channi Himmat Mohalla Dilli, Tehsil Bahu, District Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-357/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 403 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Amit Pathania S/o Mr. Chain Singh Pathania R/o H. No. 486, Jullaka Mohalla, Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 404 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Ms. Aalia Javaid Bhat S/o Mr. Javaid Ahmad Bhat R/o Baghat-e-Barzulla, Rawath Pora, Srinagar has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. Her name has been entered under Serial No. JK-355/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 405 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Zia-ul-Rahman Dar S/o Mr. Abdul Rahman Dar R/o Nowdal, Shah Mohalla, Near Jamia Masjid, Tehsil Tral, District Pulwama has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 406 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr./Ms. Ifrah Abbas Waza S/o/D/o Mr. Ghulam Abbas Waza R/o Shaheedi Mohalla, Kishtwar, W. No. 7, H. No. 436, Tehsil and District Kishtwar has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his/her provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His/her name has been entered under Serial No. JK-353/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

όόόόόόό

Notification

No. 407 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Syed Rafiq Rashid S/o Syed Abdul Rashid R/o Kaisar Mohalla, Chadoora, Mohalla Banpora, District Budgam has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-352/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 408 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Sumrashwar Singh S/o Mr. Dhrub Singh R/o W. No. 1, VPO Nagri, (Parole), District Kathua has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-351/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

(Sd.) G. M. PARRAY,

Joint Registrar (Adm.).

óóóóóóóó

Order

No. 621 Dated 15-10-2015.

It is hereby notified that in connection with Annual Darbar Move, Winter Session, 2015-16, Main Wing of the High Court and Office of Registrar Vigilance, High Court of J&K shall close at Srinagar on 31st October, 2015 (Saturday) after office hours and will reopen at Jammu on 9th of November, 2015 (Monday) F. N.

By order.

(Sd.) KANEEZ FATIMA,

Registrar General.



THE

JAMMU AND KASHMIR GOVERNMENT GAZETTE

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR, CIVIL SECRETARIATóóREVENUE DEPARTMENT

Notification No. 04-Rev. (LAK) of 2015

Dated 13-10-2015.

Whereas, the land, specifications whereof are given in Annexures õAö and õBö to this notification, is required for construction of Flyover Express Corridor from Jehangir Chowk to Rambagh, situated in Village Narsingh Garh, Tehsil and District Srinagar; and

Whereas, on the basis of the indent placed by the Project Director, (JKUSDIP) J&K Economic Reconstruction Agency, Kashmir vide his No. L.J/J/L/ERA/106-10 dated 01-04-2010, notification as required under sub-section (1) of section 4 of the J&K Land Acquisition Act, (Svt.) 1990,

Whereas, the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir vide his Letter No.746-748/LA/ERA dated 24-07-2015 has reported that the notifications issued by him under section 4 (l) of the J&K State Land Acquisition Act, was served upon the interested persons, calling objections from them to the proposed acquisition; and

Whereas, the report furnished by Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir, vide his Letter No. referred above, duly endorsed by Deputy Commissioner, Srinagar vide his No. DCS/LAS/1851/286-287 dated 01-08-2015 and Divisional Commissioner, Kashmir vide his letter No. Divcom/LAS-Acq/2048-II/1099 dated 06-08-2015 and Financial Commissioner (Revenue), J&K vide his No. FC-LS/LA-4402/2015 dated 11-08-2015, have been examined and it has been found that report of the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir regarding objections of interested persons is based on facts, hence disposed off the same being devoid of any merit; and

Whereas, the Government is satisfied, that the land particulars whereof are mentioned in Annexures õAö and õBö to this notification, is required for public purposes and that there is no alternative but to acquire the said land for construction of Flyover Express Corridor from Jehangir Chowk to Rambagh.

Now, therefore, in pursuance of section 6 of the J&K State Land Acquisition Act, Samvat, 1990, it is declared that the land mentioned in Annexures õAö and õBö to this notification is needed for public purposes viz. construction of Flyover Express Corridor from Jehangir Chowk to Rambagh, situated at Village Narsingh Garh, Tehsil and District Srinagar. Further, the Collector, Land Acquisition, Economic Reconstruction

The Collector, Economic Reconstruction Agency etc. have recommended to invoke the provisions of section 17 of Land Acquisition Act due to urgency involved in the said acquisition as the public/commuters are facing lot of discomfort/inconvenience due to the execution of project. Any delay in the execution would further cause the discomfort/inconvenience.

Therefore, in pursuance of section 17 of the J&K State Land Acquisition Act, Samvat, 1990, it is ordered that on expiry of fifteen days from the date of publication of notification under section 9 (2) of the said Act, the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir, will take possession of the aforementioned land detailed in Annexures õAö and õBö to this notification, situated at village Narsingh Garh, Tehsil and District Srinagar, required for public purposes, subject to the fulfilment of conditions prescribed under section 9 (2) and section 17-A or the J&K State Land Acquisition Act and Rule 63 of the J&K Land Acquisition Rules.

However, the Collector shall be responsible for proper title verification of all types of land involved in the case, in respect of all the interested persons/rightful claimants in accordance with the relevant laws/rules in force, while making final award in the case.

By order of the Government of Jammu and Kashmir.

(s d.) MUHAMMAD AFZAL, IAS,

Secretary to Government, Revenue Department.

óóóóóó

Annexure "A" to Notification No. 04-Rev. (LAK) of 2015 dated 13-10-2015.

Village	Tehsil	District	Khasra No.	Area
1	2	3	óóóóóóóóóóóóóó 4	5
-			óóóóóóóóóóóóóó	
				K. M. Sft.
Narsingh	Srinagar	Srinagar	495 min	00ó06ó139
Garh	(South)		495 min	016006139
			888 min	006116179
			889 min	
			890 min	
			Musha	
			888 min	01ó16ó10
			889 min	
			890 min	
			Musha	
			884 min	00ó11ó239
			885 min	016076190
			500 min	00603665
			501 min	
			Musha	
			500 min	006106250
			501 min	
			Musha	
			881 min	00ó14ó00
			598 min	00ó00ó16
			651 min	00618621
			655 min	
			Musha	
			655 min	006126234
			658 min	
			659 min	
			Musha	

No. 36] The J&K Govt. Gazette, 3rd Dec 66666666 66666666666666666666666666		
óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	όόόόόόόόόόόό <i>ό</i>	óóóóóóóóó K. M. Sft.
	655 min 658 min 659 min Musha	006166141
	659 min	00ó14ó152
	660 min	00ó16ó261
	836 min	00ó19ó120
	825 min 826 min 830 min Musha	006086147
	803 min 805 min 819 min Musha	056106133
	709 min 709 min	006076201 006156223
	1620 min 1621 min Musha	006006163
	1618 min 1619 min Musha	00600654
	1618 min 1619 min Musha	00ó00ó65
	1522 min to 1527 min 1534 min to 1540 min Musha	016086138

óóóóóóóóóóóóóóóó	δόόόόόόό	óóóóóóóóó K. M. Sft.
1522 to 1527 1534 to 1540 Musl	min	01609698
1522 to 1527 1534 to 1540 Mush	min	016126201
1550 1557 1559 1560 1551 1549 1540 Musl	min min min min min min	01606627
1550 1557 1559 1560 1551 1549 1540 Musl	min min min min min min	02602681
1562 1563 1574 Musl	min min	006106223
1562 1563 1574	min	006106228

Musha

1 2 3	4	3
óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	óóóóóóóóóóóóó	
		K. M. Sft.
	1558 min	026086174
	1559 min	
	1562 min	
	1563 min	
	1574 min	
	Musha	
	1563 min	00ó10ó43
	1564 min	
	1574 min	
	Musha	
	1563 min	00ó10ó234
	1564 min	
	1574 min	
	Musha	
	1564 min	006046114
	1572 min	
	1574 min	
	Musha	
	1564 min	006036223
	1572 min	
	1574 min	
	Musha	
	1564 min	00602622
	1572 min	
	1574 min	
	Musha	
	884 min	00ó01ó182
	884 min	00ó01ó27
	884 min	00ó01ó228
	895 min	00ó05ó174
	892 min	00609659
	860 min	00ó10ó185
	857 min	00ó02ó185
	860 min	00ó04ó84

K. M. Sft.

901 min 00ó12ó44 902 min

902 min Musha

925 min 00ó08ó76

óóóóóóóó

Total: 35ó05ó136

óóóóóóóó

óóóóóó

Village	Tehsil	District	Khasra No.	Area
óóóóóóó	δόόόόόόό	óóóóóóóóóóóó	óóóóóóóóóóóóóóó	δόόόόόόόό
1	2	3	4	5
óóóóóóó	δόόόόόόό	óóóóóóóóóóóó	óóóóóóóóóóóóóóó	δόόόόόόόό

K. M. Sft.

Narsingh Garh	Srinagar (South)	Srinagar	888 min 889 min 890 min	01614627
			070 :	00/0//2/2

879 min 006066242 881 min

óóóóóóóó

Total: 026006269

óóóóóóóó

óóóóóó

GOVERNMENT OF JAMMU AND KASHMIR, CIVIL SECRETARIAT66INFORMATION DEPARTMENT

Subject :óóConstitution of State Press Accreditation Committee for the year 2015-2016.

Reference :óóNo. INF/PR-101/2014 dated 20-05-2015 from the Director Information, J&K.

óóóóóóó

Government Order No. 26-ID of 2015

Dated 23-10-2015.

In terms of Rule 4 of the State Press Accreditation Rules, 1997, sanction is hereby accorded to the constitution of the State Press Accreditation Committee for the year 2015-16 with the following composition:óó

(1)	Director General Information, J&K	Convener
(II)	Mr. Arun Joshi, Resident Editor,	Member
	The Tribune, J&K,	
(III)	Mr. Nasir Ganai, India Today,	Member

(IV)	Mr. Neeraj Rohmetra,	Member
	Executive Editor, Daily Excelsion	
(V)	Mr. Bashir Ahmad Bashir,	Member
	Editor, Srinagar Times	
(VI)	·	Member
	Aaj Tak, President Press Club, Jammu	
(VII)	Mr. Mudassar Ali, Greater Kashmir	Member
(VIII)	Mr. Nitin Kanotra, Hindustan Times	Member
(IX)	Mr. Tauseef Mustafa, AFP	Member
(X)	Mr. Pawan Chowdhary, ABP News	Member
\	,	
(XII)	Mr. Sheikh Tariq, NDTV	Member

By order of the Government of Jammu and Kashmir.

(XII) Deputy Director Information, (PR)

(Sd.) B. B. VYAS, IAS,

Member-Secretary.

Principal Secretary to Government, Information Department.



JAMMU AND KASHMIR GOVERNMENT GAZETTE

PART II—A

Orders by Heads of Departments.

óóóóóó

CHARGE REPORTS

In pursuance to Government Order No. 1386-GAD of 2015 dated 19-10-2015, we the undersigned do hereby handover and takeover the charge of Director, Floriculture, Kashmir today on 21-10-2015 afternoon.

(Sd.) RAVINDER KUMAR, IAS.

Relieved Officer.

(Sd.) TALAT PARVEZ IQBAL ROHELLA, KAS.

Relieving Officer.

óóóóóó

Pursuant to Government Order No. 1386-GAD of 2015 dated 19-10-2015 issued under endorsement No. GAD (Ser) IAS/67/2012 dated 19-10-2015, we have in the afternoon of 20th of October, 2015 respectively made over and received charge of the Custodian General, J&K Government, Srinagar.

Station: Srinagar.

Dated: 20th of October, 2015.

(Sd.) SHAHID ANAYATULLAH, IAS.

Relieved Officer.

(Sd.) MOHAMMAD JAVED KHAN, IAS.

Custodian General.

Relieving Officer.



JAMMU & KASHMIR GOVERNMENT GAZETTE

PART II—B

Notifications, Notices and Orders by Heads of Departments.

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE DEPUTY COMMISSIONER, JAMMU.

Subject :ô Decaration under sections 06&07 of Land Acquisition Act, Svt. 1990 for land measuring 125 Kanals situated at Village Najwal, Tehsil Pargwal for construction of Border Fencing (135 Feet Wide Strip).

óóóóóóó

Notification No. 04/DCJ of 2015-16.

Whereas, the land whose specifications are given below is needed for public purpose i. e. for construction of Border Fencing (135 Feet Wide Strip) situated at Village Najwal Tehsil Pargwal, District Jammu:

District	Tehsil	Village	Kh. Nos.	Area
			óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	
1 - όδοδοδοδοδοδοδο	2 δόδοδοδοδοδοδο	3 άδάδαδοδοδοδοδο	4 5666666666666666666666666666666666666	5 όδόδόδος
				K. M.
Jammu	Pargwal	Najwal	622	01ó14
			623	01ó16
			624	00ó14
			625	00ó15
			626	00ó19
			627	00ó17
			628	01ó14
			634	00ó15
			667	05ó14
			670	00ó12
			671	04ó15
			672	03ó16
			687	00ó04
			688	01ó04
			689	01ó16
			690	00ó19
			691	01ó18
			692	01ó10
			693	00ó06

1 2	3 66666666666666	4 666666666666666666666666666666666666	5 666666666666666666666666666666666666
		695	00617
		696	02602
		697	01600
		698	00ó08
		699	03605
		700	04ó10
		702	02ó18
		703	01613
		705	00ó14
		706	00619
		707	01614
		708	01610
		709	01613
		722	01610
		723	01615
		725	01602
		727	00ó16
		728	01602
		729	01607
		730	03600
		737	02612

	K. M.
738	01607
741	01610
742	04602
743	01602
744	01602
745	01604
746	01610
748	00617
749	01607
751	00ó14
761	02617
762	01610
763	02609
764	01613
766/1	01ó04
767/1	01602
768	01615
769	01618
774	02612
775	02606

		K. M.
779		02615
780		02612
955		01605
957		01609
962		00614
963		00611
965		01607
969		01602
970		00607
971		01615
972		03617
967		04ó13 óóóóóó
	Total	125600
		óóóóóó

Whereas, notification as required under section 4 (1) of the Land Acquisition Act, 1990 Svt. was issued by the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour vide his endorsement No. SDM/K/2015/122 dated 13-04-2015;

Whereas, the undersigned duly authorized by the Government vide SRO-235 and 236 of 2009 dated 11-08-2009 to exercise the powers under sections 6&7 of the Land Acquisition Act, 1990 (Svt.) is satisfied after considering the report furnished by the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour vide letter No. SDM/K/2015/350 dated 16-05-2015 that the land is required for public purpose viz. for construction of Border Fencing (135 Feet Wide Strip) situated at Najwal, Tehsil Pargwal.

Now, therefore, it is declared under section 6 of the said Act that the aforementioned land is needed for public purpose.

Further, the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour is directed under section 7 of the said Act to take order for acquisition of the land of which specifications are given above and complete further proceedings under due process.

(Sd.) SIMRANDEEP SINGH, IAS,

Deputy Commissioner, Jammu.

όόόόόόό

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE ASSISTANT COMMISSIONER, REVENUE (COMPETENT AUTHORITY), KATHUA.

Corrigendum

Subject :ô Correction of area regarding :ô The correction of area and kind of land in the Notification No. 50 dated 15-11-2014, issued under endorsement No. DCK/LHS/2014-15/1138-48 dated 15-11-2014 in respect of land situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua (The total area increased by 01Kl).

óóóóóóó

The land measuring 72Kls-16 Mls situated at Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua was notified vide this office Notification No. 50 dated 15-11-2014, issued under endorsement No. DCK/LHS/2014-15/1138-48 dated 15-11-2014 under sub-section (1) of section 3 of the Jammu and Kashmir Underground Public Utilities (Acquisition of Rights of User in Land) Act, 2014 for the purpose namely underground laying of gas pipelines or any other utility. In this notification, the total area may be read as 73Kl-16 Ml instead of 72Kl-16 Ml, (Increased = 01 Kl having kind of soil Gair Mumkin) situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua.

The total area under acquisition of rights of user in land shall be read notified as 73 Kl-16 Ml instead of 72Kl-16 Ml, situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua.

The kind-wise breakup of land is given as :ô

Kind of land

	Nehri	Banjar Qadeem	Gari Mumkin	Area
Note :ô	óóóóóóóó	óóóóóóóóóóóóóóó	óóóóóóóóóóóóó	όόόόόόόόό <i>ό</i>
	K. M.	K. M.	K. M.	K. M.
	55-111/2	01-03	17-01½	73-16

(Sd.) ATUL GUPTA, KAS,

Assistant Commissioner, Revenue (Competent Authority), Kathua.

όόόόόόό

IN THE COURT OF ADDITIONAL SPECIAL MOBILE MAGISTRATE, BATALIK/DRASS.

Present: Tsewang Phuntsog.

State through PS. Drass V/s. 1. Abdul Jabbar S/o Mohd. Sharif R/o Nera, Ramban, Jammu

> 2. Ranjit Singh S/o Amar Singh R/o Sumbul Mode, R. S. Pora, Jammu

Case FIR No. 29/2010, PS, Drass under sections 341, 323 RPC.

General Warant of Arrest

To

Director General of Police, J&K Police.

In the above titled case, the accused Abdul Jabbar has not been causing his appearance before this Court since long. This Court is satisfied that the

Issued under my hand and Seal of the Court.

(5	(d.)	١.																														
1~	,	•	٠	• •	٠.	•	•	•	•	۰	•	•	•	٠	۰	٠	٠	٠	•	• •	 •	۰	•	۰	•	۰	•	٠	•	•	•	٥

Munsiff Additional Special Mobile Magistrate, Batalik/Drass.

óóóóóóó

BEFORE THE HONØBLE COURT OF PRINCIPAL SESSIONS JUDGE, SRINAGAR.

Present :ô Rashid Ali Dar.

State through Police Station, V/s. Kothibagh

Mohammad Shafi Bhat S/o Gh. Mohammad Bhat R/o Kursoo Raj Bagh, Srinagar

Case FIR No. 36/2002 and 56/2002 under sections 420, 467, 471 RPC of P/S, Kothibagh.

Proclamation under section 87 Cr. P. C.

Whereas, the criminal cases cited above are pending disposal before this court with charge of the criminal offences against the accused;

Whereas, in view of the continuous absence of the accused and flouting of the terms and conditions of the bail, proceedings under section 514 Cr. P. C. have already been initiated against the accused;

Whereas, presence of the accused could not be procured as the accused is concealing himself to avoid the attendance before the Court.

Proclamatin is hereby made that the said accused Mohammad Shafi Bhat is required to appear before the Court of the undersigned on 09-11-2015 at 10.30 am to be examined touching the veracity of the challan.

(Sd.)	

Principal Sessions Judge, Srinagar. óóóóóóó

NOTICE FOR GENERAL PUBLIC

The candidate whose particulars are mentioned below is claiming to have lost/gutted his Original and as well as Duplicate Qualification Certificate/s issued by J&K State Board of School Education, under serial Nos. 207 and 1189 respectively, with following particulars:ô

1.	Name	Tej Krishan
2.	Parentage	Pt. Madue Lal Dhar
3.	Residence	Langate Handwara, District Kupwara
4.	Date of Birth	20-04-1958
5.	Roll No.	434
6.	Session	1973, March
7.	Result	Passes

Now, the candidate has applied for õ2nd Duplicate Qualification Certificateö. Before, the same is processed and provided to the concerned candidate, any person/s having any objections in this regard, may please file the same before the Secretary, BOSE or to the undersigned within a period of seven days from the date of issue of this notice

Besides, the above referred õboth Qualification Certificatesö be treated as cancelled.

(Sd.)	
	Assistant Secretary Certificates, K. Div

My name and my father an ame has wrongly been written as Rajinder Gupta instead of Rajinder Prashad Resutra and Karam Chand Kasotra instead of Karam Chand Resutra in my PAN Card bearing No. AHQPRO 717E. Now, I am applying for correction. Objection, if any, may be conveyed to concerned authority within 7 days.

Rajinder Prashad Resutra,

S/o Karam Chand Resutra, R/o Plot 38, Sarwal Colony, Jammu.

óóóóóóó

Correction

I, Megha D/o Shri Chaman Lal Shivgotra R/o H. No. 333, Sector-1/A, South Extn., Trikuta Nagar, Jammu appliying for the correction of my name which has been wrongly written as Megha Shivgotra in Union Public Service Commission, Combined Medical Services Examination, 2015, bearing Roll No. 002675. Now, the correct name is Megha. Objection, if any, may be conveyed to UPSC Shahjahan Road, Dholpur House, New Delhi-110069. That Megha and Megha Shivgotra is the name of one and the same person. That I do not intend to add my surname with my name in future.

όόόόόόό

Notice

The name of my Child in his School Record i. e. Army Public School, Domana (Barnai), Jammu is written as Vikas Thapa whereas his correct name is Vikas Thappa S/o Shiv Ram R/o Village Jungwari, P/O Domana, Tehsil and District Jammu. Objection in this regard, if any, be sent to school authorities within 7 days of this notice.

Shiv Ram, F/o Vikas Thappa, R/o Jungwari, Domana, Jammu.



THE JAMMUAND KASHMIR GOVERNMENT GAZETTE

ADVERTISEMENT-C

HEADQUARTERS OF HOMEGUARDS/CIVIL DEFENCE AND SDRF, J&K, SRINAGAR.

e-NIT No. 02 of 2015

Dated 19ó10ó2015.

For and on behalf of the Governor of Jammu and Kashmir, e-Tenders in two cover system (Technical and Financial Bid) are hereby invited from

The tenders (technical bids only) will be opened online on 0261262015 at 1100 hours at Police Headquarters, Gulshan Ground, Gandhi Nagar, Jammu. In case of unforeseen circumstances, the date of opening will be next working day.

Detailed tender documents (SBD) with terms and conditions are available on J&K State e-Procurement Portal www.jktenders.gov.in.

(Sd.)																							
١	Du.	, .	•	•	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠

Addl. Director General of Police, HG/CD & SDRF, J&K, Srinagar.

óóóóóóóó

HEADQUARTERS OF HOMEGUARDS/CIVIL DEFENCE AND SDRF, J&K, SRINAGAR.

e-NIT No. 03 of 2015

Dated 19ó10ó2015.

For and on behalf of the Governor of Jammu and Kashmir, e-Tenders in two cover system (Technical and Financial Bid) are hereby invited from original manufacturers/authorized dealers having specific authorization from

The tenders (technical bids only) will be opened online on 0261262015 at 1100 hours at Police Headquarters, Gulshan Ground, Gandhi Nagar, Jammu. In case of unforeseen circumstances, the date of opening will be next working day.

Detailed tender documents (SBD) with terms and conditions are available on J&K State e-Procurement Portal www.jktenders.gov.in.

	(Sd.)
Addl. Dire	ector General of Police HG/CD & SDRF J&K, Srinagar
<u> </u>	
GOVERNMENT OF JAMMUAN DIRECTORATE GENERAL, FIRE AND EMER J&K, JAMMU.	
Extension Notice It is notified for the information of all concu	

Period of downloading From 1061162015 to 2061162015

Date of submission of online

documents

Up to 20ó11ó2015

Date of submission of Hard Copy Up to 216116201 up to 4.00 P. M.

Date of opening tenders 23ó11ó2015 or any other

convenient date

Other terms and conditions of the NIT shall remain unchanged

(Sd.)

Accounts Officer, Fire and Emergency Services, J&K, Jammu.

óóóóóóó

POLICE TELECOM. HEADQUARTERS J&K, JAMMU.

NIT No. 03 of 2015

Dated 17ó11ó2015.

1. Sealed tenders affixed with revenue stamp of Rs. 5/- are hereby invited for the supply of Data Paper of below mentioned specifications :66

Computer Data Paper 80 Col. (80) Col. Part-1, 60 GSM Dimensions 25.4 cm x 30.5 cm (1000 sheets in each packet).

2. Tenders are to be submitted on prescribed tender form which can be obtained on application from the Office of Police Telecom. Headquarters, J&K, Jammu, 1st Floor, APHQ Complex, Gulshan Ground, Jammu on payment of tender fee of Rs. 500/- in cash or money order which will not

- 3. Intending tenderers shall furnish the tender in two parts (technical bid and financial bid). Each bid shall be in separate envelop duly superscripted as tender bid and financial bid, along with name of tenderer, NIT No. and date. Sealed envelope containing technical bid and financial bid shall then be placed in one cover which shall be duly sealed and superscripted giving NIT No., date and name of tenderers and should reach this office on or before 08-12-2015 up to 1030 hrs. The technical bid will be opened on 09-12-2015 at 1500 hrs. in the Office of Director, Police Telecom., J&K, Jammu in presence of intending tenderers who may choose to be present. In case of unforeseen circumstances the date of opening of tenders received will be next working day. Financial bid shall be opened only of those tenderers who qualify technically as per serial No. 04 of this notice.
 - 4. Part 1st technical bid shall containóó
 - (a) Sample of 10 pages of Data Paper which is must showing make of Data Paper on each or on alternate page.
 - (b) Earnest money in shape of CDR/FDR only.
 - (c) A copy of this NIT affixed with revenue stamp of Rs. 5/- duly signed and stamped on every page by the tenderers in token of having understood and accepted the specifications, terms and conditions of the NIT.
 - (d) CST certificate.
 - (e) VAT clearance certificate up to March, 2015.
 - (f) A certificate that quoted rates are minimum and not above MRP as applicable to Government Department.
 - 5. Part 2nd financial bid shall containóó
 - (a) Basic unit rate (inclusive of taxes).
 - (b) Make of data paper.
- 6. Intending tenderers shall have to deposit earnest money of Rs. 25,000/- in the form of CDR/FDR pledged to Staff Officer (SSP), IGP,

- 7. Tenders received after the prescribed time and date will be rejected.

For and on behalf of the Governor.

(Du.)	(Sd.)																
-------	-------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

Staff Officer SSP (DDO) For Inspector General of Police, Telecom., J&K, Jammu.

SUPPLEMENTARY-C

óóóóóóó

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE GENERAL MANAGER, RANBIR GOVERNMENT PRESS, JAMMU (TAWI)-180005.

Short Term Tender Notice

Sealed tenders affixed with revenue stamps worth Rs. 5/- are invited from the interested parties/registered private firms for the rate contract of õRaw Material for Fabrication of Wall Calendar/Engagement Pad for the year 2016ö as per below mentioned specifications. The quotation should reach in this office of the undersigned by or before 05-12-2015 up to 12.00 Noon and shall be opened on the same day or any other date convenient to the Unit Purchase Committee of the department :66

S. No. Items Required Material with Quantity
Specification (Approx.)

- 1. Wall Calendar (i) õWire-o-Wireö Size 6 mm
 - Size 15"x 20" (ii) Hanger (Metallic) Size 15" comprised of 3 lvs.
- 2. Engagement Pad õWire-o-Wireö Size 22 mm 15,000 Nos. Size 6½"x10" comprised of 54 lvs.

Terms and Conditions:

- 1. The tenderers are advised to furnish earnest money of Rs. 1,000/- in the shape of CDR/FDR duly pledged to the General Manager, Ranbir Govt. Press, Jammu.
- 2. The rates are FOR Press included all taxes and charges.
- 3. Supply of material shall be made within 10 days from the date of placement of supply order .

For and on behalf of the Governor of Jammu and Kashmir.

(Sd.) F. H. QADRI,

16,000 Nos.

General Manager.

عمیمه جمعیت عمیمه عم



رجٹر ڈنمبر ہے کے۔33

جمُّو الصَّمْبِرُكُورِثَمْنُ طُّ كُرْ طُ

جلد نمبر 128_ جمول مورخه 3 ومبر 2015ء بمطابق 12 اگراهنا 37 وروار نمبر 36

إشتهارات

ازعدالت چیف جوڈ بیثل مجسٹریٹ کھوعہ سرکار بنام بلبیر سنگھ وغیرہ

مثل نمبر 121 / حيالان، تاريخ دائره 2010-07-21

بذريعه علت نمبر 202 سال 2010ء، تقانه پوليس كھنور

جرائم زير دفعات : 341,324/323 RPC

وارنٹ گشتی عام زیرد نعہ 512 ض ف ہرخاص وعام

بخلاف ملزم: بلبیر سنگه عرف پمال ولد بوگراج ساکنه چک پرتاپ سنگه مخلاف ملزم: مبلی مور مختصیل وضلع کشوعه

حُكم بنام: المكاران يوليس رياست جمول وكشمير

مقدمه مندرجه عنوان ألصدر مين ملزم كافي عرصه سے غير حاضر عدالت

چلاآر ہاہے اور سردست دستیابی کی کوئی اُمیدنہ ہے۔

لہٰذا آپ کوشکم دیاجا تاہے کہ ملزم مٰدکور جہاں کہیں بھی دستیاب ہو،کوگر فتار کر کے روبر دعدالت مٰذا پیش کریں۔وارنٹ مٰذا تا دستیا بی ملزم زیر کارر ہے گا۔

08-06-2015 : يَرِّعُ

وستخط: چيف جوڙيشل مجسر بيك كھوعه۔

از عدالت فسط ایر نیشنل سیشن جج جمول سرکار بنام وین کماروغیره

مثل نمبری سیش /74، دائره 2006-03-28

تاريخ كارروائي 2015-11-10، آئنده تاريخ بيشي 2015-12-28

علت نمبر 75سال2005ء ، تھانہ پولیس نوآباد

427/435/447/34 RPC : جرائمُ زير دفعات

وارنٹ گشتی عام زردنعہ 512 ض

بخلاف ملزم: وِ بِن كما رعرف بهوت ولدرومیش كما رسا كنه مكان نمبر 349، لین نمبر 6 شکتی نگر جمول -

حُكم بنام : المكاران بوليس رياست جمول وتشمير

مقدمه مندرجه عنوان ألصدر میں ملزم مذکور ہ عرصہ دراز سے دستیاب نہ

ہور ہاہے۔

البذابذربعه وارنٹ گشتی مذاحگم واختیار دیا جاتا ہے کہ آپ ملزم مذکور جہال کہیں بھی اندر حدود ریاست جمول و کشمیر دستیاب ہو، کو گرفتار کر کے روبر وعدالت پیش کریں ۔ وارنٹ مذاتا دستیاب ملزم مذکور زیر کارر ہے گا۔
آج تاریخ 10 ماہ نومبر سال 2015ء ہمارے دستخط و مہر عدالت سے جاری ہوا۔

سركار بنام وين بعوت وغيره

مثل نمبری سیشن/5، تاریخ دائرہ 2015-05-20-20-20-20 مثل نمبری سیشن/5، تاریخ دائرہ 2015-20-20-28 تاریخ بیشی 2015-12-28 علت نمبر231 سال 2003ء تھانہ پولیس با ہوفورٹ

180 - جمول وكشمير كورنمنث كزث نبر 36 مورخه 3 وتمبر 2015 ء بمطابق 12 اگراهنا 1937 ضميمت

. جرائم زير دفعات 307/341/34 RPC 4 / 25, A. Act

وارنٹ گشتی عام زیردنعہ512ض

بخلاف ملزم: وِ پِن بھوت ولدرومیش چندرقوم مہاجن ساکندم کان نمبر 349/6 شکتی نگر جموں حُکم بنام : اہلکاران پولیس ریاست جموں وکشمیر۔

مقدمه مندرجه عنوان ألصدر ميں ملزم مذكور ه عرصه دراز سے دستياب

نہ ہور ہاہے ۔

الهذا آپ کوبذر بعد وارنٹ گشتی مذاطکم واختیار دیا جاتا ہے کہ آپ ملزم مذکور جہاں کہیں بھی اندر حدود ریاست جموں وکشمیر دستیاب ہو،کوگرفتار کر کے روبروپیش کریں۔وارنٹ مذاتا دستیا بی ملزم مذکور زیر کارر ہے گا۔

آج تاریخ 10 ماہ نومبر سال 15 20ء ہمارے دستخط ومہر عدالت سے حاری ہوا۔

وستخط: فسط ايديشنل سيشن جج جمول -

0+0+0+0+0+0



THE

JAMMU & KASHMIR GOVERNMENT GAZETTE

PART III

Laws, Regulations and Rules passed thereunder.

ôôôó

JAMMU AND KASHMIR
STATE ELECTRICITY REGULATORY COMMISSION
(GRID INTERACTIVE ROOFTOP SOLAR PHOTO VOLTAIC
SYSTEMS BASED ON NET METERING) REGULATIONS, 2015

Notification No. 47-JKSERC of 2015

Dated 15-10-2015.

In exercise of powers conferred under section 138 read with sections 55, 60 and 71(1) (e) of the J&K Electricity Act, 2010 (Act XIII of 2010) and all other powers enabling it in this behalf, the Jammu and Kashmir State Electricity Regulatory Commission hereby makes the following Regulations for Grid Connected Rooftop Solar Photo Voltaic (SPV) Systems based on Net Metering.

- 1. Short title and commencementóó
 - 1.1 These Regulations may be called the Jammu and Kashmir State Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015, in short, JKSERC Net Metering Regulations, 2015.
 - 1.2 These Regulations shall come into force from the date of publication of the same in the Government Gazette.
- 2. Definitions and interpretationóó
 - 2.1 In these Regulations, unless the context otherwise requires,óó
 - (a) õActö means the Jammu and Kashmir Electricity Act, 2010 (Act XIII of 2010), as amended from time to time;
 - (b) õAgreementö means an agreement signed by the distribution licensee with the eligible consumer for net metering arrangement ;
 - (c) õBilling Cycleö or õBilling Periodö means the period for which regular electricity bills as specified by the Commission are issued by the distribution licensee to different categories of consumers;
 - (d) õCommissionö means the Jammu and Kashmir State Electricity Regulatory Commission ;
 - (e) õConnected Loadö means the sum of the rated capacities in KW/HP of all energy consuming including portable apparatus duly wired and connected to the power supply system in the consumerøs premises. However, this shall not include the load of extension plug sockets, standby or spare

energy consuming apparatus, installed through change over switch, which cannot be operated simultaneously and any other load exclusively meant for fire-fighting purposes. In case of domestic consumers, load of geysers plus heaters or of air conditioners without heaters, whichever is higher, is to be considered. Any equipment which is under installation and not connected electrically, equipment stored in warehouse/showrooms either as spare or for sale is not to be considered as part of the connected load;

- (f) õConsumerö means any person who is supplied with electricity for his own use by a licensee or the Government or by any other person engaged in the business of supplying electricity to the public under the Act or any other law for the time being in force and includes any person whose premises are for the time being connected for the purpose of receiving electricity with the works of distribution licensee, the Government or such other person, as the case may be ;
- (g) õContract Demandö or õContracted Loadö means the maximum demand (in kW, kVA or BHP units) contracted by the consumer in Agreement with the Licensee. The contract demand cannot be reduced to less than 60% of the sanctioned/connected load;
- (h) õDistribution Licenseeö or õLicenseeö means a person granted a licence under section 14 of the Act and authorized to operate and maintain a distribution system for supplying electricity to the consumers in his area of supply and includes J&K Power Development Department;

- - (i) õEligible Consumerö means a consumer of electricity in the area of supply of distribution licensee, who uses a rooftop SPV System installed in his premises to offset part or all of the consumerøs own electrical requirements, given that such systems can be iself ownedø or ithird party ownedø;
 - (j) õFinancial Yearö or õYearö means period beginning from first day of April and ending with thirty first day of March of next year;
 - (k) õInterconnection Pointö means the interface of rooftop solar power generation facility under net metering arrangements with the network of distribution licensee and shall normally be the point where net meter is installed;
 - (l) õInvoiceö means the monthly bill or a supplementary bill or a monthly invoice or a supplementary invoice raised by the distribution licensee to the consumer;
 - (m) õkWpö means kilo Watt peak;
 - (n) õNet Meteringö means an arrangement under which rooftop SPV System installed at eligible consumer premises delivers surplus electricity, if any, through net meter to distribution licensee for offsetting the electricity supplied by distribution licensee during the applicable or subsequent billing period but within settlement period;
 - (o) õObligated Entityö means the entity mandated by the Commission under clause (e) of sub-section (1) of section 71 of the Act to fulfill the renewable purchase obligation and identified under JKSERC (Renewable Purchase Obligation, its compliance and

- - (p) õPremisesö means rooftops or/and elevated areas on the land, building or infrastructure or part or combination thereof in respect of which a separate meter or metering arrangement have been made by the distribution licensee for the supply of electricity;
 - (q) õRenewable Energy Certificateö (REC) means the certificate issued in accordance with the procedures prescribed in Central Electricity Regulatory Commission (Terms and Conditions for recognition and issuance of Renewable Energy Certificate for Renewable Energy Generation) Regulations, 2010 as amended from time to time;
 - (r) õRooftop Solar Systemö means the Solar Photo Voltaic System installed in the premises of the consumer that uses solar energy for direct conversion into electricity through photo voltaic technology;
 - (s) õSanctioned Loadö means the load in kW, kVA or BHP, which the Licensee has agreed to supply from time to time subject to the governing terms and conditions. The total Connected Load is required to be sanctioned by the competent authority;
 - (t) õSettlement Periodö means the period beginning from first day of April of a year and ending with thirty first day of March of next year;
 - (u) õSolar Meterö means a unidirectional energy meter installed as an integral part of the net metering

system at the point at which electricity generated by Solar Photo Voltaic (SPV) System, is delivered to the main panel of eligible consumer;

- (v) õState Agencyö means the agency as designated by the Commission under Regulation 9 of the JKSERC (Renewable Power Purchase Obligation, its compliance and REC Framework Implementation) Regulations, 2011;
- (w) õSupply Codeö means the Jammu and Kashmir State Electricity Regulatory Supply Code, 2011, as amended from time to time;
- (x) õTariff Orderö in respect of a licensee means the Order issued by the Commission for the relevant year for that licensee indicating the rates to be charged by the licensee from various categories of consumers for supply of electrical energy and for other services;
- (y) õThird Party Ownerö means a developer who is generating solar energy on a rooftop but does not own the rooftop, and who also enters into a lease/ commercial agreement with the rooftop owner.
- 2.2 (a) All other words and expressions used in these regulations although not specifically defined hereinabove, but defined in the Act, shall have the meaning assigned to them in the Act;
 - (b) All other words and expressions used herein but not specifically defined in these regulations or in the Act but defined under any other law passed by the State Legislature or Regulations framed under the Act,

shall have the meaning assigned to them in such Law/Regulations.

- 2.3 Abbreviations used in these Regulations shall have the meanings as stated in (Annexure-I).
- 3. Scope and applicationóó
 - 3.1 These Regulations shall apply to distribution licensee and consumers of such distribution licensee in the State of Jammu and Kashmir.
 - 3.2 Any consumer in the area of supply of distribution licensee may install rooftop solar system under net metering arrangement whichóó
 - (a) Shall be of minimum 1 kWp and up to 1 MWp (AC side) capacity with or without battery backup support;
 - (b) Shall be located in the consumer premises;
 - (c) Shall interconnect and operate safely in parallel with the distribution licensee's network.
 - 3.3 These regulations do not preclude the right of any person to undertake rooftop solar projects above 1 MWp capacity through alternative mechanism.
 - 3.4 The net metering facility shall also be applicable to such consumers who have installed rooftop solar system before commencement of these regulations subject to compliance of these regulations.
- 4. General conditions.óóThe distribution licensee shall offer the provision of net metering arrangement to the eligible consumer, who

Provided, the consumer is eligible to install the grid connected rooftop solar system of the rated capacity as specified in these regulations :

Provided further that the distribution licensee shall offer the provision of net metering to the consumer for the target capacity as specified in these regulations:

Provided also that the interconnection of such system with the grid is undertaken as specified in CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013, as amended from time to time:

Provided also that the distribution licensee shall accept the SPV power as per the useful life of the SPV System as per CERC Regulations.

- 5. Capacity target for distribution licenseeóó
 - 5.1 The distribution licensee shall provide net metering arrangement to eligible consumers as long as the total capacity (in MW) of rooftop solar systems does not exceed the target capacity determined by the Commission:

Provided that initially, a maximum cumulative capacity to be installed by eligible consumers under net metering in the area of supply of each distribution licensee shall be as decided by the Commission. Thereafter, the target capacity shall be reviewed on yearly basis by the Commission:

Provided further the cumulative capacity of rooftop solar system to be allowed to a particular distribution transformer shall not exceed 20% of the rated capacity of the distribution transformer.

- 5.2 The distribution licensee shall provide information regarding distribution transformer level capacity available for connecting rooftop solar system under net metering arrangement within six (6) months from the date of notification of these regulations. The distribution licensee thereafter shall update the distribution transformer level capacity available and the cumulative capacity of the rooftop solar systems installed under net metering arrangement on yearly basis by 30th April and shall provide the information on its website as well as to the Commission.
- 6. Eligible consumer and individual project capacityóó
 - 6.1 All eligible consumers of electricity in the area of the supply of distribution licensee can participate in the solar rooftop net metering arrangement subject to target capacity.
 - 6.2 The maximum capacity of rooftop solar system shall not exceed 50% of the sanctioned load of the consumer (for kVA conversion to kW use a power factor of 0.9):

Provided that the installed capacity shall not be less than 1 kWp and shall not exceed 1MWp (AC side) for a single eligible consumer :

Provided further that a variation in the rated capacity of the system within a range of five per cent shall be allowed.

- 7. Procedures for application and registrationóó
 - 7.1 The Eligible Consumer who proposes to install a solar energy system in his premises shall apply in the application form (Annexure-II), which the distribution

licensee shall notify on its website as downloadable as well as make available at the relevant sub-divisional office of the distribution licensee along with the application/processing fee of Rs. 100/kW subject to a maximum of Rs. 10,000.

- 7.2 The licensee shall acknowledge the receipt of the application form and register the application and shall process the application in the order of the receipt.
- 7.3 Within fifteen (15) working days of receipt of the Eligible Consumerøs application, the distribution licensee shall provide written notice that it has received all documents required by the standard interconnection agreement or indicate how the application is deficient.
- 7.4 The Distribution Licensee shall assess the feasibility and intimate the same to the Eligible Consumer within thirty (30) days from the receipt of completed application. The feasibility shall be valid for a period of six months, unless extended by the Distribution Licensee:

Provided that if the Distribution Licensee determines that an interconnection study is necessary as per sub-regulation 7.5, the Distribution Licensee shall intimate feasibility or otherwise within sixty (60) days from the receipt of completed application.

- 7.5 While intimating the feasibility for the connection of Rooftop PV Solar Power Plant as specified in sub-regulation 7.4, the Distribution Licensee shall also intimate the Eligible Consumeróó
 - (a) The details of documents to be submitted by the Eligible Consumer;
 - (b) Particulars of any deficiencies, if noticed, along with instructions to remove such defects ;
 - (c) Details of any interconnection study required.

7.6 The Distribution Licensee shall, on receipt of the report on removing defects, if any, and the documents submitted under sub-regulation 7.5, convey the approval within ten (10) working days from the date of receipt:

Provided that if the deficiency as per sub-regulation 7.5 is not removed by the Eligible Consumer within sixty (60) days from the date of receipt of such intimation to the Eligible Consumer, the application shall stand cancelled and the application/processing fee shall be forfeited.

- 7.7 The interconnection agreement (Annexure-III) shall be executed by the distribution licensee with the eligible consumer within thirty (30) days of the accord of approval under Regulation 7.6.
- 8. Interconnection with the Grid, Standards and Safetyóó
 - 8.1 The interconnection of the Rooftop PV Solar Power Plant with the network of the distribution licensee shall be made as per the technical specifications and standards for connectivity provided in the Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013, as amended from time to time.
 - 8.2 The connectivity levels at which the Rooftop PV Solar Power Plants shall be connected with the grid are as specified below :óó
 - S. Connected load of Connectivity level No. Eligible Consumer
 - 1. Up to 5 kW 240 V-single phase
 - 2. Above 5 kW and 415 V-three phase up to 100 kW
 - 3. Above 100 kW HT/EHT level

- 8.3 The above connectivity norms are applicable to all the solar power generators who seek connectivity with network of the distribution licensees. EHT/HT consumers may install solar power generators at LT/HT voltage and connect them to their LT/HT system.
- 8.4 In the interconnection of rooftop PV solar energy generator with the local distribution licensee¢s grid, the relevant provisions of the Central Electricity Authority (Measures relating to Safety and Electric Supply) Regulations, 2010 as amended from time to time shall apply.
- 8.5 The solar energy generator shall be responsible for safe operation, maintenance and rectification of defect of its system up to the interconnection point beyond which the responsibility of safe operation, maintenance and rectification of any defect in the system including the net meter shall rest with the distribution licensee.
- 8.6 The consumer shall be solely responsible for any accident to human being/animals, whatsoever, (fatal/nonfatal) that may occur due to back feeding from the Solar Plant when the grid supply is off. The distribution licensee reserves the right to disconnect the consumer in installation at any time in the event of such exigencies to prevent accident or damage to man and material.
- 8.7 The tests as per distribution licenseeøs standards shall be done to ensure the quality of power generated from the Solar PV Systems.
- 8.8 Any alternate source of supply shall be restricted to the consumer sometwork and the consumer shall be responsible to take adequate safety measures to prevent

battery power/diesel generator power/backup power extending to distribution licenseeøs LT grid on failure of distribution licenseeøs grid supply.

- 8.9 The distribution licensee shall have the right to disconnect the rooftop PV solar energy generator from its system at any time in the following conditions :óó
 - i. Emergencies or maintenance requirement on the distribution licensee¢s electric system;
 - ii. Hazardous condition existing on the distribution licensee@s system due to operation of solar energy generator or protective equipment as determined by the Distribution Licensee/Transmission Licensee/SLDC.
 - iii. Adverse electrical effects, such as power quality problems, on the electrical equipment of the other consumers of the distribution licensee caused by the solar energy generation as determined by the distribution licensee.
- 8.10 Subject to sub-regulation 8.5 above, the distribution licensee may call upon the rooftop PV solar energy generator to rectify the defect within a reasonable time.
- 8.11 The Rooftop PV Solar Power Plant should be capable of detecting an unintended islanding condition. These systems must have anti-islanding protection to prevent any unfavorable conditions including failure of supply. IEC-62116 shall be followed to test islanding prevention measure for grid connected photovoltaic inverters.
- 8.12 Every Rooftop PV Solar Power Plant shall be equipped with automatic synchronization device :

Provided that Rooftop PV Solar Power Plant using inverter shall not be required to have separate

- - 8.13 The Rooftop PV Solar Power Plant operating in parallel with electricity system shall be equipped with the following protective functions to sense abnormal conditions on electricity system and cause the Rooftop PV Solar Power Plant to be automatically disconnected from the electricity system or to prevent the Rooftop PV Solar Power Plant from being connected to electricity system inappropriately:óó
 - i. Over and under voltage trip functions if voltage reaches above 110% or below 80% respectively with a clearing time up to two seconds; however, appropriate licensee may prescribe a narrower range of voltage for the purpose;
 - ii. Over and under frequency trip functions, if frequency reaches 50.5 Hz or below 47.5 Hz with a clearing time up to 0.2 seconds; however, appropriate licensee may prescribe a narrower range of frequency for the purpose;
 - iii. The Rooftop PV Solar Power Plant shall cease to energize the circuit to which it is connected in case of any fault in this circuit.
 - iv. A voltage and frequency sensing and time delay function to prevent the Rooftop PV Solar Power Plant from energizing a de-energized circuit and to prevent the Rooftop PV Solar Power Plant from reconnecting with electricity system unless voltage and frequency is within the prescribed limits and are stable for at least sixty seconds; and

- v. A function to prevent the Rooftop PV Solar Power Plant from contributing to the formation of an unintended island, and cease to energize the electricity system within two seconds of the formation of an unintended island.
- 8.14 The equipment of the Rooftop PV Solar Power Plant shall meet following requirements, namely :óó
 - Circuit Breakers or other interrupting equipment shall be suitable for their intended application with the capability of interrupting the maximum available fault current expected at their location;
 - ii. The Rooftop PV Solar Power Plant and associated equipment shall be designed so that the failure of any single device or component shall not potentially compromise the safety and reliability of the electricity system;
 - iii. Paralleling device of the Rooftop PV Solar Power Plant shall be capable of withstanding 220% of the nominal voltage at the interconnection point.
- 8.15 Every time the Rooftop PV Solar Power Plant of the Eligible Consumer is synchronized to the electricity system, it shall not cause voltage fluctuation greater than ±5% at the point of interconnection.
- 8.16 After considering the maintenance and safety procedures, the distribution licensee may require a Rooftop PV Solar Power Plant to provide a manually operated isolating switch between the Rooftop PV Solar Power Plant and the electricity system, which shall meet following requirements:
 - i. Allow visible verification that separation has been accomplished;

- - ii. Include indications to clearly show open and closed positions;
 - iii. Be capable of being reached quickly and conveniently twenty four hours a day by licensee¢s personnel without requiring clearance from the applicant;
 - iv. Be capable of being locked in the open position;
 - v. May not be rated for load break nor may have feature of over-current protection; and
 - vi. Be located at a height of at least 2.44 m above the ground level.
 - 8.17. Prior to synchronization of the Rooftop PV Solar Power Plant for the first time with electricity system, the applicant and the appropriate licensee shall agree on the protection features and control diagrams.
 - 8.18 The power conditioning unit shall have the features of filtering out harmonics and other distortions before injecting the energy into the system of the distribution utility. The technical standards, power quality standards and inverter standards shall be as per (Annexure-IV) of these regulations or any other standards as may be specified by CEA from time to time.
- 9. Third Party Owned Rooftop Solar PV System based on net metering66
 - 9.1 The third party owned rooftop solar PV net metering model may consist of the developer or intermediaries leasing out solar PV system to interested rooftop owners. The owner of the premises provides the rooftop and engages a turnkey installer to design and install the system. The installers may also offer integrated service of leasing, commissioning and maintenance of Solar PV System to owners and guaranteeing standards of performance.

- 9.2 In the third party owned solar PV system based on net metering, the electricity generated from such plants/ system shall be used to meet the eligible consumerøs internal electricity needs, while the excess generation shall be fed into the Grid (network of licensee) on Net Metering basis.
- 9.3 The developer shall continue to be the owner of equipment in third party owned system, to qualify for claiming depreciation on capital cost for the solar PV system with associated direct tax benefits, if any.
- 9.4 For all intents and purposes, the distribution licensee shall deal with the consumer only and arrangement between rooftop owner and developer shall be personal to them.

10. Metering arrangementóó

- 10.1 The metering system shall be as per the regulations for installation and operation of meters for rooftop solar systems under net metering arrangement specified in these regulations.
- 10.2 The schematic arrangement for interconnection of Rooftop and Small PV Solar Power Plant with the Distribution Licensee's grid is shown at (Annexure-V). There shall be two meters. The metering arrangement shall be as per (Annexure-VI).
- 10.3 The bi-directional (net meter) shall be installed at the interconnection point of the Eligible Consumer with the network of the distribution licensee :

Provided that for the existing consumers, the consumer meter shall be replaced with the bi-directional/net meter :

Provided further that consumers having ABT compliant meters shall not be required to install additional net meter.

- 10.4 Solar meter shall be installed at the solar facility after the inverter to measure the solar generation.
- 10.5 These meters shall have the facility for downloading meter readings using Meter Reading Instrument (MRI). Check meters shall be mandatory for rooftop solar systems having capacity more than 250 kW. For installations size of less than and equal to 250 kW, the solar check meters would be optional:

Provided that the cost of new/additional meter (s) shall be borne by the Eligible Consumer and installed and owned by the distribution licensee:

Provided, if bills are prepared on the basis of MRI downloads or if meter reading is taken on the basis of remote meter reading and the consumer wishes to have a record of the reading taken, he shall be allowed so by the licensee.

10.6 The meters installed shall be jointly inspected and sealed on behalf of both the parties and shall be interfered/tested or checked only in the presence of the representatives of the consumer and distribution licensee or as per the supply code specified by the Commission:

Provided that the Eligible Consumer shall follow the metering specifications and provisions for placement of meter as developed by the distribution licensee from time to time and as per the supply code:

Provided further that in case the Eligible Consumer is under the ambit of time of day (TOD) tariff, meters compliant of recording time of day consumption/generation shall be employed.

- 10.7 The meter readings taken by the distribution licensee shall form the basis of commercial settlement.
- 10.8 The technical standards for meters shall be as per (Annexure-VII) and shall comply with the standards specified by CEA from time to time.
- 10.9 The meters installed for Rooftop PV Solar Power Plants with capacity above 250 kWp shall have the communication port for exchanging real time information with Distribution Licensee.

11. Energy Accounting and Settlementóó

- 11.1 The accounting of the electricity generated, consumed and injected by the rooftop solar system under these regulations shall become effective from the date of connectivity of such system with the network of distribution licensee.
- 11.2 The procedure for billing and energy accounting shall be as underóó
 - (a) For each billing cycle the consumer shall receive an energy account statement showing quantum of electricity injected by the eligible consumer in the billing period, electricity supplied by the distribution licensee in the billing period, net billed electricity for payment by the consumer for that billing cycle and net carried over electricity to the next billing period separately.
 - (b) In case the electricity injected exceeds the electricity consumed from licensees supply system during the billing cycle such excess injected electricity shall be carried forward to the next billing cycle as electricity banked and may be utilized in the next billing cycle(s) within the settlement period. In such a case,

- - (c) In case the electricity supplied by the distribution licensee during any billing period exceeds the electricity injected by the Eligible Consumer, the distribution licensee shall raise a bill for net electricity consumption as per applicable tariff of that category after taking into account any electricity credit balance from previous billing period;
 - (d) In case the Eligible Consumer is under the ambit of TOD tariff, the electricity consumption in any time block i. e. peak hours, off peak hours etc. shall be first compensated with the electricity injected in the same time block. Any excess injection over and above the consumption in any other time block in a billing cycle shall be accounted as if the excess injection occurred during non-peak hours;
 - (e) The surplus energy measured in kWh/kVAh shall be utilized to offset the consumption measured in kWh/kVAh and may not be utilized to compensate any other fee and charges imposed by the licensee as per the orders of the Commission;
 - (f) The Monthly Minimum Charges (MMC), if applicable, shall be leviable on total consumption of the consumer of each billing cycle and not on net consumption. A normative power factor of 0.9 shall be considered for conversion of kWh to kVAh, wherever applicable;
 - (g) The distribution licensee shall also take the reading of solar meter for recording total solar power generated by Solar PV system of consumer;

- (h) The distribution licensee in addition to consumer tariff shall be eligible to raise invoice/bills for any other charges as allowed by the Commission;
- (i) In case of any dispute in billing, the consumer can approach the licensee, who will deal the complaint under provisions of Regulations 6.23 to 6.26 of the Supply Code. In case the consumer feels aggrieved by the licensee's disposal of the complaint, the consumer can approach Consumer Grievances Redressal Forum and Electricity, Ombudsman in accordance with JKSERC (Consumer Grievances Redressal Forum, Ombudsman and Consumer Advocacy) Regulations, 2012, as amended from time to time.
- 11.3 The electricity generated from a rooftop solar system shall not exceed 90% of the electricity consumption by the consumer in a settlement period. The excess energy generated in a billing cycle shall be allowed to be carried forward to the next billing cycle up to the end of the settlement period:

Provided that in the event of electricity generated exceeds 90% of the electricity consumed at the end of the settlement period no payment shall be made by the distribution licensee and shall not be carried forward to next settlement period and the same shall be treated as inadvertent injection:

Provided also that at the beginning of each settlement period, cumulative carried over solar electricity injected shall be reset to zero.

11.4 All the rules and regulations applicable to the consumers of the distribution licensee for the applicable category shall also be applicable to the eligible consumer who uses the rooftop solar system.

- 12. Applicability of other charges.66The rooftop solar system under net metering arrangement whether self-owned or third party owned, installed on the premises of eligible consumer, shall be exempted from various provisions of JKSERC (Terms and Conditions for Intra State Open Access) Regulations, 2015, as amended from time to time:

Provided that the Commission may review such exemption from time to time.

- 13. Eligibility to participate under Renewable Energy Certificate (REC) Mechanism.óóThe eligibility for issuance of renewable energy certificate shall be as per the eligibility criteria specified under Central Electricity Regulatory Commission (Terms and Conditions for recognition and issuance of Renewable Energy Certificate for Renewable Energy Generation) Regulations, 2010, as amended from time to time.
- 14. Renewable Purchase Obligation (RPO).óóThe quantum of electricity consumed by eligible consumer, who is not defined as obligated entity, from the rooftop solar system under net metering arrangement shall qualify towards compliance of Renewable Purchase Obligation (RPO) for the distribution licensee.
- 15. *Penalty*.óóIn case of failure to meet the requirements under these regulations for net metering, the solar power generator shall be liable to pay penalty as decided by the Commission from time to time.

16. Termination of agreementóó

- 16.1 The eligible consumer may terminate the agreement at any time by giving 30 days prior written notice to the licensee.
- 16.2 If an eligible consumer breaches any term of the agreement and does not remedy the breach within 30 days of receipt of written notice from the distribution

- - 16.3 Eligible Consumer, upon termination of the agreement, shall disconnect forthwith the photovoltaic system from licenseegs distribution system.
- 17. Power to give directions.óóThe Commission may from time to time issue such directions and orders as considered appropriate for implementation of these regulations.
- 18. Removal of difficulties.óóIf any difficulty arises in giving effect to the provisions of these regulations, the Commission may, by an order, make such provision, not being inconsistent with the Act and these regulations, which appears to the Commission to be necessary for removal of the difficulties.
- 19. Power to relax.óóThe Commission may by general or special order, for reasons to be recorded in writing and after giving an opportunity of hearing to the parties likely to be affected, may relax any of the provisions of these regulations on its own or on an application made before it by an interested person.
- 20. Power to amend.óóThe Commission may from time to time add, vary, alter, suspend, modify, amend or repeal any provisions of these regulations.

Ву	order	of	the	Com	mission	1.							
							(S d	.)				•••••	
											S	Secret	ary,
				J&K	State	Elec	tricity	Re	egulato	orv	Cor	nmiss	ion.

Srinagar.

óóóóóóó

LIST OF ABBREVIATIONS

AC Alternating Current

AT&C Aggregate Technical and Commercial

BHP Brake Horse Power

BIS Bureau of Indian Standards

CB Circuit Breaker

CEA Central Electricity Authority

CT Current Transformer

DC Direct Current

EHT Extra High Tension
EHV Extra High Voltage
FOR Forum of Regulators

GBI Generation Based Incentive

GIS Geographic Information System

GoI Government of India

GoJK Government of Jammu and Kashmir

GPS Geographic Positioning System

GSM Global System for Mobile Communications

GSS Grid Sub-station HT High Tension

IEC International Electro-technical Commission

IEEE Institution of Electrical and Electronics Engineers

JKSERC J&K State Electricity Regulatory Commission

KV Kilo Volt

KVA Kilo Volt Ampere

KW Kilo Watt

KWh Kilo-Watt hour

LT Low Tension

MNRE Ministry of New and Renewable Energy

MPLS Multiprotocol Label Switching

MVA Mega Volt-Ampere

NM Net Meter

O&M Operation and Maintenance

PCU Power Conditioning Unit

PT/VT Potential/Voltage Transformer

RE Renewable Energy

REC Renewable Energy Certificate

RPO Renewable Purchase Obligation

SLDC State Load Despatch Centre

SM Solar Meter

SPV Solar Photo Voltaic

TVM Tri-Vector Meter

References of the Standards

Standard Reference

IS 13779-1999 Standards for single or polyphase electrostatic watt

hour meters

IS 14697 Standards for static transformer operated watt hour

meters and VAR hour meters

IEEE 61000 Equipment standards to control/curtail flicker

IEEE 519 Standards for Limitation for Total Harmonic

Distortion

26 The J&K Govi 666666666666666666666666666666666666	i. Gazette, 15th Oct., 2015/23rd Asv., 1937. [No. 29-2 0666666666666666666666666666666666666
IEC 61646	Standards for thin film terrestrial photovoltaic (PV) modules-Design qualification and type approval
IEC 61730	Standard for Photovoltaic (PV) module safety qualification-Part1: Requirement foconstruction Part 2: Requirements for testing
	IEC 61701 Standards for Salt mist corrosion testing for modules used in coastal corrosive atmosphere
IEC 60068-2	(1, 2, 14, 30) Standards for power conditioning unit/inverters for efficiency measurement and environment tests
IEC 60502	Standards for power cables with extruded insulation and their accessories for rated voltages from 1 kV(Um=1.2 KV up to 30 Kv(Um=36 kV)
IEC 60227	Standards for polyvinyl chloride insulated cables of rated voltages up to and including $450/750\ V$
IEC 62116	Standards for utility-inter connected photovoltaic inverters-Test procedures of islanding prevention measures.

óóóóóó

Format for Application for Solar Power Connectivity

To

The Sub-divisional Officer/ Designated Officer Distribution Licensee

[Name of office]
Date: [date]

I/we herewith apply for a solar energy net metering connection at the service connection and for the solar PV plant of which details are given belowóó

- 1. Name of applicant
- 2. Address of applicant
- 3. Service connection number/Consumer ID
- 4. (a) Sanctioned load
 - (b) Contracted load/demand
- 5. Service connection tariff
- 6. Telephone number(s)
- 7. Email ID
- 8. Solar PV plant capacity (kilo Watts)
- 9. Solar grid inverter make and type
- 10. Solar grid inverter has automatic isolation protection (Y/N) ?
- 11. Has a Solar Generation Meter been installed (Y/N) ?
- 12. Expected date of commissioning of solar PV sytem

PV Plant/inverter for standards required under the Regulations.
Name:
Signature:
Net metering Application Acknowledgement
Received an application for a solar energy net metering connection from
Name:
Date :
Service Connection Number/Consumer ID:
Application Registration No. :
Solar Plant Capacity:
Name of Officer:
Signature:
Designation/(Name of Discom)
<u> </u>

13. Details of test certificates of Solar

Annexure-III

Net Metering interconnection agreement

This Agreement is made and entered into at (location)on this (date) day of (month) year between.
The Eligible Consumer, by the name ofhaving premises at (address) as first party.
And
Distribution Licensee (herein after called as Licensee) and reprsented by(designation of office) and having its registered office at (address) as second party of the agreement.
And whereas, the Licensee agrees to provide grid connectivity to the Eligible Consumer for injection of the electricity generated from his SPV plant of capacitykilowatts into the power system of Licensee and as per conditions of this agreement and JKSERC (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015, issued by the Jammu and Kashmir State Electricity Regulatory Commission.
Both the parties hereby agree to as follows :óó

1. Eligibility—

Eligibility for net metering has been specified in the relevant regulations of the Jammu and Kashmir State Electricity Regulatory Commission. Eligible Consumer has to meet the standards and conditions for being integrated into grid/distribution system.

Technical and Interconnection Requirements—

The Eligible Consumer agrees that his solar generation plant and net metering system will conform to the standards and requirements specified in JKSERC (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015 and in the following regulations and codes as amended from time to time: 66

- i. CEA
 øs (Technical Standards for connectivity of the Distributed Generating Resources)
 Regulations, 2013;
- ii. Central Electricity Authority (Installation and Operation of Meters) Regulation, 2006;
- iii. JKSERC Electricity Regulatory Supply Code 2011.
- 2.2 Eligible Consumer agrees that he has installed or will install, prior to connection of Photovoltaic System to Licensee distribution system, an isolation device (both automatic and inbuilt within inverter and external manual relays) and agrees for the Licensee to have access to and operation of this, if required and for repair and maintenance of the distribution system.
- 2.3 Eligible Consumer agrees that in case of a power outage on Licensees system, photovoltaic system will disconnect/isolate automatically and his plant will not inject power into Licensees distribution system.
- 2.4 All the equipment connected to distribution system shall be compliant with relevant International (IEEE/IEC) or Indian Standards (BIS) and installations of electrical equipment must comply with Central Electricity Authority (Measures of Safety and Electricity Supply) Regulations, 2010.
- 2.5 Eligible Consumer agrees that licensee will specify the interface/interconnection point and metering point.
- 2.6 Eligible Consumer and licensee agree to comply with the relevant CEA & JKSERC Regulations in respect of operation and

- - 2.7 Due to Licensees obligation to maintain a safe and reliable distribution system, Eligible Consumer agrees that if it is determined by the Licensee that Eligible Consumers photovoltaic system either causes damage to and/or produces adverse effects affecting other consumers or Licensees assets, Eligible Consumer will have to disconnect photovoltaic system immediately from the distribution system upon direction from the Licensee and correct the problem at his own expense prior to a reconnection.
 - 2.8 The consumer shall be solely responsible for any accident to human being/animals whatsoever (fatal/non-fatal) that may occur due to back feeding from the solar plant when the grid supply is off. The licensee reserves the right to disconnect the consumer installation at any time in the event of such exigencies to prevent accident or damage to life and property.

3. Clearances and Approvals—

3.1 The Eligible Consumer shall obtain all the necessary approvals and clearances (environmental and grid connection related) before connecting the photovoltaic system to the distribution system.

4. Access and Disconnection—

- 4.1 Licensee shall have access to metering equipment and disconnecting means of the solar photovoltaic system, both automatic and manual, at all times.
- 4.2 In emergency or outage situation, where there is no access to the disconnecting means, both automatic and manual, such as a switch or breaker, Licensee may disconnect service to the premises of the Eligible Consumer.

5. Liabilities—

- 5.1 Eligible Consumer and Licensee shall indemnify each other for damages or adverse effects from either party negligence or intentional misconduct in the connection and operation of photovoltaic system or Licensee distribution system.
- 5.2 Licensee and Eligible Consumer shall not be liable to each other for any loss of profits or revenues, business interruption losses, loss of contract or loss of goodwill, or for indirect, consequential, incidental or special damages, including, but not limited to, punitive or exemplary damages, whether any of the said liability, loss or damages arise in contract, or otherwise:

Provided that in case of any dispute in respect of clause 5.1 and 5.2 above, the decision of the Commission shall be final and binding on both the parties.

- 5.3 Licensee shall not be liable for delivery or realization by Eligible Consumer for any fiscal or other incentive provided by the Central/State Government beyond the scope specified by the Commission in its relevant order.
- 5.4 The Licensee may consider the quantum of electricity generation from the rooftop solar PV system under net metering arrangement towards RPO. (Applicable only in case of Eligible Consumer who is not defined as an Obligated Entity).
- 5.5 The proceeds from CDM benefits shall be retained by the Licensee.

6. Commercial Settlement—

6.1 All the commercial settlement under this agreement shall follow the Net Metering Regulations, 2015 issued by JKSERC.

7. Connection Costs-

7.1 The Eligible Consumer shall bear all costs related to setting up of photovoltaic system including metering and interconnection

8. Termination—

- 8.1 The Eligible Consumer can terminate agreement at any time by providing Licensee with 30 days prior notice.
- 8.2 Licensee has the right to terminate Agreement on 30 days prior written notice, if Eligible Consumer commits breach of any of the term of this Agreement and does not remedy the breach within 30 days of receiving written notice from Licensee of the breach.
- 8.3 Eligible Consumer shall upon termination of this Agreement, disconnect the photovoltaic system from Licensees distribution system in a timely manner and to Licensees satisfaction.

In witn	less, whereof, Mr	for and on beha	lf
of	. (Eligible Consumer) and M	Irfor and on beha	ılf
of	(Licensee) sign this agr	eement in two originals.	

Eligible Consumer Distribution Licensee

Name Name

Address Designation

Service Connection No./ Office Address

Consumer ID

όόόόόόό

Inverter Standards—

Harmonics Standards-

Technical and interconnection requirements Parameters

Annexure-IV Annexure-IV	Solution inverter should comply with IEC 61683/IS 61683 for efficiency and measurements and should comply with IECS of 60068-2 (1, 2, 14, 30)/Equivalent BIS Standard for environmental testing.	Inverter should supervise the grid condition continuously and in the event of grid failure (or) under voltage (or) & provided size inverter should be disconnected by the Circuit Breaker/Auto switch provided in the inverter and shall on comply with requirements specified at Regulation 8 of these regulations.	standards——Standards——	As per the standard IEEE 519, the permissible individual harmonics level shall be less than 3% (for both voltages; and current harmonics) and Total Harmonics Distortion (THD) for both voltage and current harmonics of the system \$\circ{9}{9}\circ{9}\circ{9}{9}\circ{9}{9}\circ{9}\circ{9}{9}\circ{9}{9}\circ{9}{9}\circ{9}\circ{9}{9}\circ{9}\ci	Technical and interconnection requirements Parameters — — — — — — — — — — — — — — — — — — —	Parameter Reference Requirement Requirement $0.00000000000000000000000000000000000$
Inverter Standards—	Inverter should 60068-2 (1, 2, 14, 30)	Inverter should supervis voltage, Solar System should comply with requirements spe	Harmonics Standards—	As per the stand and current harmonics shall be less than 5%.	Technical and interc	Parameter όδοδόδοδοδοδοδοδοδο 1 όδοδοδοδοδοδοδοδοδο Overall conditions of service

No. 29-2] The J&K C	Govt. Gazette, 1 óóóóóóóóóóóó	5th Oct., 2015// óóóóóóóóóóóóó	23rd Asv., 1937. 35
Compliance with Grid Standards as regards the frequency, voltage and protection coordination.	Compliance with the specifications of the meters.	Compliance with safety provisions for electrical installations and apparatus.	The Total Harmonic Distortion (THD) for voltage at operate interconnection point should not exceed 5%. For operate current distortion limits, the Total Demand Distortion (TDD) in terms of ratio of available short operation circuit current to the demand current (ISC/IL) shouldown remain within limits specified for various harmonics operation different TDD values.
 (i) Central Electricity Authority (Grid Standard) Regulations, 2010; (ii) JKSERC Grid Code; and (iii) JKSERC (Distribution Performance Standards) Regulations, 2006. 	Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended from time to time	Central Electricity Authority (Measures of Safety and Electricity Supply) Regulations, 2010	IEEE 519 CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
Overall Grid Standards	Meters	Safety and supply	Harmonic Requirements Harmonic Current


36 óóó	The J&K Govt. 0	Gazette, 15th Oct., 2015/23rc రదరదదదదదదదదదదదద బ్ర	l Asv., 1937. [1 óóóóóó óó óó ô
όδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	Synchronization CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 Synchronization CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Synchronization a grid frequency synchronization device. Every time the generating station is synchronized to the electricity system, it shall not cause voltage fluctuation greater than +/- 5% at point of inter connection.	The voltage operating window should minimize nuisance tripping and should be within operating range of 80% to 110% of the nominal connected voltage. The photovoltaic system must isolate itself from the grid within a clearing time of 2 seconds.	Operation of Photovoltaic system should not cause over yoltage flicker in excess of the limits stated in over a short period of time (10 minutes) should over a short period of time (10 minutes) should
ιόδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	ίδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
όδόδόδοδοδοδοδοδοδοδο 1	όδοδοδοδοδοδοδοδοδοδο Synchronization	Voltage	Flicker

over a short period of time (10 minutes) should $\overset{\circ}{\circ}_{\overset{\hookrightarrow}{\circ}}_{\overset{\hookrightarrow}{\circ}}$ be <=1. Long-term flicker (Plt) : The flicker severity evaluated $\overset{\circ}{\circ}_{\overset{\hookrightarrow}{\circ}}_{\overset{\hookrightarrow}{\circ}}$

No. 29-2 óóóóóó	2] The J&K Go 6ô 666666666666	ovt. Gazette, 15th (Oct., 2015/23rd A óóóóóó (%óóóóóóó	Asv., 1937. 37 óóóóóóóóó ô ô
over a long period of time (typically 2 hours) should 9.50 be <=0.65.	There should be over and under frequency trip functions with a clearing time of 0.2 seconds, when the Distribution system frequency deviates outside the specified conditions (50.5 Hz on upper	Photovoltaic system should not inject DC power more than 0.5% of full rated output at the interconnection point or 1% of rated inverter output current into distribution system under any operating conditions.	When the output of the inverter is greater than 50%, the power output from the inverter shall have a laggi power factor of greater than 0.9.	The photovoltaic system must island/disconnect itself within IEC standard stipulated time in the event of fault, voltage or frequency variations.
	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 side and 47.5 Hz on lower side).	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
	Frequency	DC Injection	Power Factor	Islanding and Disconnection

óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	ύδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όσο σο σ
Ī	7	•
όδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	Σοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όδο δο δ
Overload and Overheat	CEA (Technical Standards for Connectivity of the Distributed	The inverter should have the facility to automatically switch off in case of overload
	Generation Resources) Regulations, 2013	or overheating and should restart when normal conditions are restored.
Paralleling Device	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	Paralleling device of photovoltaic system shall be capable of withstanding 220% of the normal voltage at the interconnection point.

Schematic Arrangement for interconnection of Rooftop and Small PV Solar Power Plant with the Distribution Licensee's/Grid

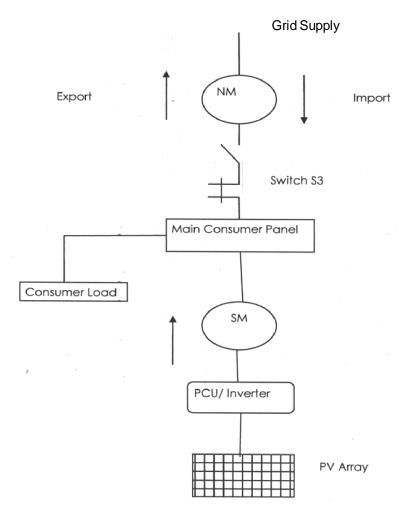

Normally, Solar Generation shall be connected with Grid. When grid fails, Inverter controlled Switch S3 Opens and on restoration of grid S3 Closes.

Abbreviations:


NM: Net Meter, SM: Solar Meter, PCU: Power Conditioning Unit.

óóóóóóó


Annexure-VI

Net Metering configuration options

(1) Two meter configuration without storage

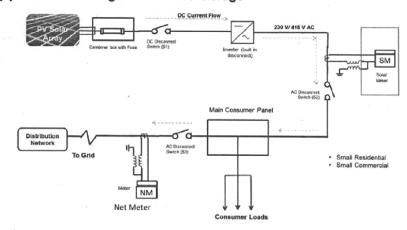

(2) Two meter configuration with storage

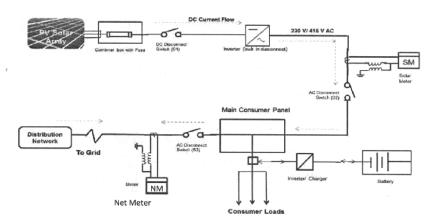

Annexure-VII

Specification for meters for net metering:

(a) Meter for Solar Generation Measurements:

Solar Meter Major Technical Parameters

όδόδό 1 όδόδό 5.	όδο δο δ	ίδοδοδοδοδοδοδοδο 3 Ιδοδοδοδοδοδοδοδοδο 10-60	ίδδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	δόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όδοδοδοδοδοδοδοδοδο 5 δοδοδοδοδοδοδοδοδοδ
9	Accuracy Class	1.0	1.0	0.5S	0.5S
7.	Indian Standard or IEC to IS 13779-1999 which conforming	IS 13779-1999	IS 13779-1999	IS 14697, IS 13779	IS 14697, IS 13779
∞.	Import-export feature	Forward import	Forward import	Forward import	Forward import
9.	Communication Port/Protocol	Optical/DLMS	Optical, RS-232/DLMS	Optical, RS-232/ DLMS	Optical, RS-232/ DLMS
(b)	Meter for Net Metering Measurements:	surements:			
	Net Meter Major Technical Parameters	arameters			
S. S.	Technical Parameters	Connectivity	Connectivity at 415 V and below voltage level	voltage level	Connectivity at above 415 V voltage level
óóóóć	όδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	λόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	ύδόδοδοδοδοδοδοδοδο meters	δόδοδοδοδοδοδοδοδοδοδο CT operated	όδοδοδοδοδοδοδοδο CT-PT Operated
óóóóć 1	000000000000000000000000000000000000	3 3 3 3	Σ οδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	\$6666666666666666666666666666666666666	\delta \d

HT/EHV supply

and up to 100 kW contract demand

and up to 15 kW connected load

Up to 5 kW connected load

Applicability

Above 5 kW

Above 15kW

No. 29-2] óóóóóóóô	The J&K Govt. Gazette, 15th Oct., 2015/23rd Asv., 1937. 666666666666666666666666666666666666	43 ô ô
5		

.5	Number of phases and wires	Single Phase, 2 Wire	Three Phase, 4 Wire	Three Phase, 4 Wire	Three Phase, 4 Wire
33	Measurand(s)	kWh	kWh	kWh, kVAh, kVA, PF	kWh, kVAh, kVA, PF, Max. demand
4.	Standard Voltage and frequency	240 V	3x240 V (P-N), 415 V (P-P) 50±5%	3x240 V (P-N), 415 V (P-P) 50±5%	3x63.5 V (P-N), 110 V (P-P) 50±5%
5.	Current Rating	10-60	10-60	1 Amp	1 Amp
9.	Accuracy Class	1.0	1.0	0.58	0.58
7.	Indian Standard or IEC to IS 13779-1999 which conforming	IS 13779-1999	IS 13779-1999	IS 14697, IS 13779	IS 14697, IS 13779
∞.	Import-export feature	Forward import	Forward import	Forward import	Forward import
.6	Communication Port/Protocol	Optical/DLMS	Optical, RS-232/DLMS	Optical, RS-232/ DLMS	Optical, RS-232/ DLMS



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Wed., the 7th Oct., 2015/15th Asv., 1937. [No. 27-k

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóLABOUR AND EMPLOYMENT DEPARTMENT

Notification

Srinagar, the 7th October, 2015.

SRO-355.óóIn exercise of the powers conferred by sub-section (3) of section 18 of the Building and Other Construction Workers (Regulation of Employment and Conditions of Service) Act, 1996 (27 of 1996), the Government of Jammu and Kashmir hereby appoint the following persons

1. Honøble Minister, Labour and Employment, Chairperson J&K.

Central Government Nominee

 Welfare Commissioner (HQ), Ministry of Labour and Employment, Govt. of India, New Delhi.

Members representing the State Government

3. Administrative Secretary to Government, Member Finance Department.

4. Administrative Secretary to Government, Member Labour and Employment Department.

5. Labour Commissioner/Chief Inspector Member of Inspections under Building and Other Construction Workers (RE & ES)
Act, 1996,

6. Special Secretary to Government, Member Social Welfare Department

7. Additional Secretary to Government, Member Department of Law, Justice and Parliamentary Affairs.

Members representing Employers/Principal Employers

8. Secretary (Technical), Power Development Member Department.

9. Special Secretary to Government, Tourism Member Department

10. Chief Engineer PWD (R&B), Jammu. Member

11. Special Secretary to Government, Member Housing and Urban Development Department.

12. Joint Director (Planning), Rural Member Development Department.

By order of the Government of Jammu and Kashmir.

(Sd.) SHAILENDRA KUMAR, IAS,

Commissioner/Secretary to Government, Labour and Employment Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATÓ ÓREVENUE DEPARTMENT

Notification

Srinagar, the 7th October, 2015.

SRO-356.66In exercise of the powers conferred by sub-rule (1) of Rule 14 read with Rule 18 of the Jammu and Kashmir Lambardari Rules, 1980, and in supersession of Notification SRO-407 of 2014 dated 14th of October, 2014, the Government hereby appoint Deputy Commissioner, Kupwara, Shri Kumar Rajeev Ranjan, as the Returning Officer for the purpose of holding the Election of Lambardar of Village Bicherwari, Tehsil Handwara of District Kupwara.

By order of the Government of Jammu and Kashmir.

(Sd.) MUHAMMAD AFZAL, IAS,

Secretary to Government, Revenue Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 8th Oct., 2015/16th Asv., 1937. [No. 28-a

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 8th October, 2015.

SRO-357.66In exercise of the powers conferred by section 5 of the Jammu and Kashmir Levy of Tolls Act, Samvat 1995, the Government hereby exempt from payment of levy of toll, leviable under the said Act,

the items shown in Annexure to this notification, to be imported into the State by the Chief Patron and Executive Director, -Karuna Social Entrepreneurship Foundationø, New Delhi for organizing a panel discussion regarding õSave The Dal and a sufi music show at Botanical Garden on 8th to 10th October, 2015ö subject to condition that the authorized officer of the said organization undertakes that equipments/items are exclusively meant for the aforesaid use only and shall be returned after completion of the event.

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.

óóóóóóó

S. No.	Equipments/items
1.	Sounds
2.	Lights
3.	Table
4.	Chairs
5.	Trussing
6.	Carpet
7.	Console
8.	Fabrication Material
9.	Wood
10.	Black Masking Cloth
11.	Kitchen Items
12.	Cabling
13.	Decor Items

(Sd.) BHARAT SINGH, KAS,

Additional Secretary to Government, Finance Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 8th Oct., 2015/16th Asv., 1937. [No. 28-b

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 8th October, 2015.

SRO-358.óóIn exercise of the powers conferred by sub-section (2) of section 3 of the Jammu and Kashmir Entry Tax on Goods Act, 2000, (Act No. IV of 2000), the Government hereby exempt from payment of

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.

óóóóóóó

	quipments/items óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó
2.	Lights
3.	Table
4.	Chairs
5.	Trussing
6.	Carpet
7.	Console
8.	Fabrication Material
9.	Wood
10.	Black Masking Cloth
11.	Kitchen Items
12.	Cabling
13.	Decor Items

(Sd.) BHARAT SINGH, KAS,

Additional Secretary to Government, Finance Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIAT66HEALTH AND MEDICAL EDUCATION DEPARTMENT

Notification

Srinagar, the 8th of October, 2015.

SRO-360.66In exercise of the powers conferred by section 36 of the Dentist Act, 1948 (Central Act of XVI of 1948) read with Rule 49-A of the Jammu and Kashmir State Dental Council Rules, 2004, the Government hereby directs that the Jammu and Kashmir State Dental Council shall maintain a Register of Dental Hygienists/Dental Mechanics under the provisions of the said Act/Rules.

By order of the Government of Jammu and Kashmir.

(Sd.) DR. M. K. BHANDARI, IAS,

Secretary to Government, Health and Medical Education Department.



THE

JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Fri., the 9th Oct., 2015/17th Asv., 1937. [No. 28-e

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIAT66CONSUMER AFFAIRS AND PUBLIC DISTRIBUTION DEPARTMENT

Notification

Srinagar, the 9th of October, 2015.

SRO-361.óóIn exercise of the powers conferred by section 4 of the Jammu and Kashmir Consumer Protection Act, 1987, read with rule 3 of the Jammu and Kashmir Consumer Protection Rules,1987 and in

Choudhary Zulfiqar Ali, Chairman
 Honøble Minister, Consumer Affairs and
 Public Distribution Department and
 Tribal Affairs Department

Shri Saurabh Bhagat, IAS, Member-Secretary
 Secretary to Government,
 Consumer Affairs and
 Public Distribution Department

Member of Legislative Assembly:

 Shri Javaid Beigh, Member Hon
øble MLA

Member of Legislative Council:

 Shri Javaid Mirchal, Member Hon
 ble MLC

2. Shri Yuvraj Vikramditya Singh, Member Honøble MLC

Representatives of Autonomous Organization:

 Shri Karpal Dev Sharma, Member President, Akhar Bhartia Ghrak Panchayat

2. Shri Om Khajuria, Member Ex-Corporator

3. Shri Manish Gupta Member

No. 28-e1	The J&K Govt. Gazette, 9th Oct., 2015/17th Asv., 1937.		3
111111		^	^
00000000	οδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	$^{\circ}$	$^{\circ}$

Representatives of Consumer Organization/Consumers:

1. Shri D. R. Danish, Member

President, Consumer Prot. Organization

2. Shri Vikram Gaur, Member

President, Consumer Welfare Org., Jammu

3. Shri Manzoor Hussain Shah, Member

Advocate Rajouri

4. Shri Mushtaq Ahmad Daryal Member

President Jamia Masjid Traders

Association, Jammu

Representatives of Women:

1. Smt. Shanti Devi, Member

Honøble Ex. MLA

2. Smt. Seema Shakhar Khajuria, Member

Advocate Jammu

Representatives of Trade and Industrialists:

1. Shri Sheikh Ashaq, Member

President, KCCI

2. Shri Yashpal Gupta, Member

President, Retailers Association,

Jammu

3. Shri Rakesh Gupta, Member

President, Chamber of Commerce and

Industry, Jammu

Persons capable to represent consumer interests not specified above :

1. Shri Bashir Ahmad Mir, Member

Kangan

2. Shri Nazir Yatto, Member

Charar Sharief

3. Shri Bharat Kumar Member

S/o Shri Ashok Kumar, H. No. 201/3, Channi,

Jammu

By order of the Government of Jammu and Kashmir.

(Sd.) SAURABH BHAGAT, IAS,

Secretary to Government, CA & PD Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóDEPARTMENT OF LAW, JUSTICE AND PARLIAMENTARY AFFAIRS (Judicial Administration Section)

Notification

Srinagar, the 10th of October, 2015.

SRO-362.óóIn exercise of the powers conferred by sub-section (1) of section 492 of the Code of Criminal Procedure, Samvat 1989, and in partial modification of notification SRO-181 dated 17-06-2015, the Government hereby appoint Chief Prosecuting Officer, Sopore as Special Public Prosecutor for conduct of cases before the Court of Additional District and Sessions Judge, Sopore till further orders.

By order of the Government of Jammu and Kashmir.

(Sd.) MOHAMMAD ASHRAF MIR,

Secretary to Government, Department of Law, Justice and Parliamentary Affairs.



JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-g

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóÓDEPARTMENT OF LAW, JUSTICE AND PARLIAMENTARY AFFAIRS

Notification

Srinagar, the 12th October, 2015.

SRO-363.66In exercise of the powers conferred by sub-section (1) of section 12 of the Code of Criminal Procedure, Samvat 1989, the Government hereby appoint the below mentioned officers to be the executive Magistrates of the First Class who shall exercise all the powers of an

S/Shri

- 1. Bashir Ahmad Bhat, Sub-Divisional Magistrate, Sopore;
- 2. Ashiq Hussain Wani, Hq. Assistant to Deputy Commissioner;
- 3. Irfan Bhadur, Tehsildar, Baramulla;
- 4. Bilal Ahmad Najar, Tehsildar, Sopore;
- 5. Sayed Fahim Bihaqi, Tehsildar, Kawarhama;
- 6. Abrar Inayat, Tehsildar Khole;
- 7. Jaffar Hussain Shiekh, Tehsildar, Uri;
- 8. Javid Ahmad Zargar, Tehsildar, Tangmarg;
- 9. Ghulam Nabi Wani, Tehsildar, Wagoora.

By order of the Government of Jammu and Kashmir.

(Sd.) MOHAMMAD ASHRAF MIR,

Secretary to Government, Department of Law, Justice and Parliamentary Affairs.



JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-h

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 12th October, 2015.

SRO-364.66In exercise of the powers conferred by sub-section (2) of section 3 of the Jammu and Kashmir Entry Tax on Goods Act, 2000, (Act No. IV of 2000), the Government hereby exempt from payment of entry tax, leviable under the said Act, the material which includes, food grains, tents, iron rods, lights, wires, bulbs and other decoration items to be

imported into the State by Bhagwan Shree Lakshmi Narayan Dham, Jammu for holding õPrabhu Kripa Duk Nivaran, Samagamö at Bari Brahmna, District Samba w. e. f. 13th to 19th October, 2015, provided that the Convenors of the said organization undertake that the material so imported into the State are exclusively meant for the aforesaid use only and shall be returned after completion of the event.

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-i

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 12th October, 2015.

SRO-365.66In exercise of the powers conferred by section 5 of the Jammu and Kashmir Levy of Tolls Act, Samvat 1995 (Act No. VIII of 1995), the Government hereby exempt from payment of levy of tolls, leviable under the said Act, the material which includes, food grains, tents, iron rods, lights, wires, bulbs and other decoration items to be imported into

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.



JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 3rd Dec., 2015/12th Agra ὁὁφοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιοιο	., 1937. óóóóóóó l English	[No. 36 óóóóóó Vernacu-
CONTENTS	Pages	lar pages
PART I-Aô Appointments, promotions, transfers and leave of absence sanctioned by the Governor, Government and the Ministers	338-342	
PART I-Bó Notifications, Communiques and General Orders by the Government and the Ministers	413-422	
PART 11-A6 Appointments, promotions, transfers and leave of absence sanctioned by Heads of Departments	71-72	
PART II- Bó Notifications, Notices and Orders by Heads of Departments, Provincial Heads, Magistrates and other officers competent to issue public notices under any law or rule	445-454	
PART II-Có Notifications, Notices and Orders by Election Commission of India, Chief Electoral Officer, Jammu and Kashmir and other Officers of the Department, Election Petitions and Judgements of Election Tribunal		
PART III- Laws, Regulations and Rules passed thereunder		
PART IV6 Reprints from the Government of India Gazette or Gazettes of others Governments		
PART Vó Information and Statistics (a) Rates and prices in the State (b) Rates and wages (c) Crop Report and Forecasts (d) Whether Observations (e) Vital Statistics		
SUPPLEMENT-AóTrade		
Monthly Imports and Exports from the State		
SUPPLEMENT-B6Police		
SUPPLEMENT-CóAdvertisements	149-154	177-180

Printed at the Ranbir Government Press, Jammu.

PART I-A

Jammu & Kashmir Government-Orders

óóóóóóóó

HIGH COURT OF JAMMU AND KASHMIR AT SRINAGAR.

Notification

No. 400 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Jagdish Lal Sharma S/o Mr. Parma Nand Sharma R/o H. No. 107, Lane No. 10, Greater Kailash, Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-358/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 401 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Firdous Ahmad Rather S/o Mr. Mohd. Ahsan Rather R/o Arin, Bandipora, Id-Gah Mohalla has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 402 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Arihant Gupta S/o Mr. Suman Gupta R/o 521, Sector-7, Channi Himmat Mohalla Dilli, Tehsil Bahu, District Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-357/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 403 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Amit Pathania S/o Mr. Chain Singh Pathania R/o H. No. 486, Jullaka Mohalla, Jammu has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 404 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Ms. Aalia Javaid Bhat S/o Mr. Javaid Ahmad Bhat R/o Baghat-e-Barzulla, Rawath Pora, Srinagar has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. Her name has been entered under Serial No. JK-355/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 405 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Zia-ul-Rahman Dar S/o Mr. Abdul Rahman Dar R/o Nowdal, Shah Mohalla, Near Jamia Masjid, Tehsil Tral, District Pulwama has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 406 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr./Ms. Ifrah Abbas Waza S/o/D/o Mr. Ghulam Abbas Waza R/o Shaheedi Mohalla, Kishtwar, W. No. 7, H. No. 436, Tehsil and District Kishtwar has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his/her provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His/her name has been entered under Serial No. JK-353/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

όόόόόόό

Notification

No. 407 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Syed Rafiq Rashid S/o Syed Abdul Rashid R/o Kaisar Mohalla, Chadoora, Mohalla Banpora, District Budgam has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-352/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

óóóóóóóó

Notification

No. 408 Dated 05-10-2015.

It is hereby notified that vide High Court Order dated 29-09-2015 Mr. Sumrashwar Singh S/o Mr. Dhrub Singh R/o W. No. 1, VPO Nagri, (Parole), District Kathua has been admitted and enrolled as an Advocate on the Roll of Jammu and Kashmir Bar Council provisionally for a period of one year from the date of issuance of this notification, subject to the verification of his provisional/LL.B Degree Certificate and verification of his Character and antecedent from the concerned agency. His name has been entered under Serial No. JK-351/15 in the Roll of Advocates maintained by this Registry.

The renewal/extension of provisional license/enrolment must be sought before the date of expiry unless the absolute/final enrolment as an Advocate is ordered therebefore.

(Sd.) G. M. PARRAY,

Joint Registrar (Adm.).

óóóóóóóó

Order

No. 621 Dated 15-10-2015.

It is hereby notified that in connection with Annual Darbar Move, Winter Session, 2015-16, Main Wing of the High Court and Office of Registrar Vigilance, High Court of J&K shall close at Srinagar on 31st October, 2015 (Saturday) after office hours and will reopen at Jammu on 9th of November, 2015 (Monday) F. N.

By order.

(Sd.) KANEEZ FATIMA,

Registrar General.



THE

JAMMU AND KASHMIR GOVERNMENT GAZETTE

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR, CIVIL SECRETARIATóóREVENUE DEPARTMENT

Notification No. 04-Rev. (LAK) of 2015

Dated 13-10-2015.

Whereas, the land, specifications whereof are given in Annexures õAö and õBö to this notification, is required for construction of Flyover Express Corridor from Jehangir Chowk to Rambagh, situated in Village Narsingh Garh, Tehsil and District Srinagar; and

Whereas, on the basis of the indent placed by the Project Director, (JKUSDIP) J&K Economic Reconstruction Agency, Kashmir vide his No. L.J/J/L/ERA/106-10 dated 01-04-2010, notification as required under sub-section (1) of section 4 of the J&K Land Acquisition Act, (Svt.) 1990,

Whereas, the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir vide his Letter No.746-748/LA/ERA dated 24-07-2015 has reported that the notifications issued by him under section 4 (l) of the J&K State Land Acquisition Act, was served upon the interested persons, calling objections from them to the proposed acquisition; and

Whereas, the report furnished by Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir, vide his Letter No. referred above, duly endorsed by Deputy Commissioner, Srinagar vide his No. DCS/LAS/1851/286-287 dated 01-08-2015 and Divisional Commissioner, Kashmir vide his letter No. Divcom/LAS-Acq/2048-II/1099 dated 06-08-2015 and Financial Commissioner (Revenue), J&K vide his No. FC-LS/LA-4402/2015 dated 11-08-2015, have been examined and it has been found that report of the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir regarding objections of interested persons is based on facts, hence disposed off the same being devoid of any merit; and

Whereas, the Government is satisfied, that the land particulars whereof are mentioned in Annexures õAö and õBö to this notification, is required for public purposes and that there is no alternative but to acquire the said land for construction of Flyover Express Corridor from Jehangir Chowk to Rambagh.

Now, therefore, in pursuance of section 6 of the J&K State Land Acquisition Act, Samvat, 1990, it is declared that the land mentioned in Annexures õAö and õBö to this notification is needed for public purposes viz. construction of Flyover Express Corridor from Jehangir Chowk to Rambagh, situated at Village Narsingh Garh, Tehsil and District Srinagar. Further, the Collector, Land Acquisition, Economic Reconstruction

The Collector, Economic Reconstruction Agency etc. have recommended to invoke the provisions of section 17 of Land Acquisition Act due to urgency involved in the said acquisition as the public/commuters are facing lot of discomfort/inconvenience due to the execution of project. Any delay in the execution would further cause the discomfort/inconvenience.

Therefore, in pursuance of section 17 of the J&K State Land Acquisition Act, Samvat, 1990, it is ordered that on expiry of fifteen days from the date of publication of notification under section 9 (2) of the said Act, the Collector, Land Acquisition, Economic Reconstruction Agency, Kashmir, will take possession of the aforementioned land detailed in Annexures õAö and õBö to this notification, situated at village Narsingh Garh, Tehsil and District Srinagar, required for public purposes, subject to the fulfilment of conditions prescribed under section 9 (2) and section 17-A or the J&K State Land Acquisition Act and Rule 63 of the J&K Land Acquisition Rules.

However, the Collector shall be responsible for proper title verification of all types of land involved in the case, in respect of all the interested persons/rightful claimants in accordance with the relevant laws/rules in force, while making final award in the case.

By order of the Government of Jammu and Kashmir.

(s d.) MUHAMMAD AFZAL, IAS,

Secretary to Government, Revenue Department.

óóóóóó

Annexure "A" to Notification No. 04-Rev. (LAK) of 2015 dated 13-10-2015.

Village	Tehsil	District	Khasra No.	Area
1	2	3	óóóóóóóóóóóóóó 4	5
-			óóóóóóóóóóóóóó	
				K. M. Sft.
Narsingh	Srinagar	Srinagar	495 min	00ó06ó139
Garh	(South)		495 min	016006139
			888 min	006116179
			889 min	
			890 min	
			Musha	
			888 min	01616610
			889 min	
			890 min	
			Musha	
			884 min	00ó11ó239
			885 min	016076190
			500 min	00603665
			501 min	
			Musha	
			500 min	006106250
			501 min	
			Musha	
			881 min	00ó14ó00
			598 min	00ó00ó16
			651 min	00618621
			655 min	
			Musha	
			655 min	006126234
			658 min	
			659 min	
			Musha	

No. 36] The J&K Govt. Gazette, 3rd Dec 66666666 66666666666666666666666666		
óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	όόόόόόόόόόόό <i>ό</i>	óóóóóóóóó K. M. Sft.
	655 min 658 min 659 min Musha	006166141
	659 min	00ó14ó152
	660 min	00ó16ó261
	836 min	00ó19ó120
	825 min 826 min 830 min Musha	006086147
	803 min 805 min 819 min Musha	056106133
	709 min 709 min	006076201 006156223
	1620 min 1621 min Musha	006006163
	1618 min 1619 min Musha	00600654
	1618 min 1619 min Musha	00ó00ó65
	1522 min to 1527 min 1534 min to 1540 min Musha	016086138

óóóóóóóóóóóóóóóó	δόόόόόόό	óóóóóóóóó K. M. Sft.
1522 to 1527 1534 to 1540 Musl	min	01609698
1522 to 1527 1534 to 1540 Mush	min	016126201
1550 1557 1559 1560 1551 1549 1540 Musl	min min min min min min	01606627
1550 1557 1559 1560 1551 1549 1540 Musl	min min min min min min	02602681
1562 1563 1574 Musl	min min	006106223
1562 1563 1574	min	006106228

Musha

1 2 3	4	3
óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	óóóóóóóóóóóóó	
		K. M. Sft.
	1558 min	026086174
	1559 min	
	1562 min	
	1563 min	
	1574 min	
	Musha	
	1563 min	00ó10ó43
	1564 min	
	1574 min	
	Musha	
	1563 min	00ó10ó234
	1564 min	
	1574 min	
	Musha	
	1564 min	006046114
	1572 min	
	1574 min	
	Musha	
	1564 min	006036223
	1572 min	
	1574 min	
	Musha	
	1564 min	00ó02ó22
	1572 min	
	1574 min	
	Musha	
	884 min	00ó01ó182
	884 min	00ó01ó27
	884 min	00ó01ó228
	895 min	00ó05ó174
	892 min	00609659
	860 min	00ó10ó185
	857 min	00ó02ó185
	860 min	00ó04ó84

K. M. Sft.

901 min 00ó12ó44 902 min

902 min Musha

925 min 00ó08ó76

óóóóóóóó

Total: 35ó05ó136

óóóóóóóó

óóóóóó

Village	Tehsil	District	Khasra No.	Area
óóóóóóó	δόόόόόόό	óóóóóóóóóóó	óóóóóóóóóóóóóóó	δόόόόόόόό
1	2	3	4	5
óóóóóóó	δόόόόόόό	óóóóóóóóóóóó	óóóóóóóóóóóóóóó	δόόόόόόόό

K. M. Sft.

Narsingh Garh	Srinagar (South)	Srinagar	888 min 889 min 890 min	01614627
			070 :	00/0//2/2

879 min 006066242 881 min

óóóóóóóó

Total: 026006269

óóóóóóóó

óóóóóó

GOVERNMENT OF JAMMU AND KASHMIR, CIVIL SECRETARIAT66INFORMATION DEPARTMENT

Subject :óóConstitution of State Press Accreditation Committee for the year 2015-2016.

Reference :óóNo. INF/PR-101/2014 dated 20-05-2015 from the Director Information, J&K.

óóóóóóó

Government Order No. 26-ID of 2015

Dated 23-10-2015.

In terms of Rule 4 of the State Press Accreditation Rules, 1997, sanction is hereby accorded to the constitution of the State Press Accreditation Committee for the year 2015-16 with the following composition:óó

(1)	Director General Information, J&K	Convener
(II)	Mr. Arun Joshi, Resident Editor,	Member
	The Tribune, J&K,	
(III)	Mr. Nasir Ganai, India Today,	Member

(IV)	Mr. Neeraj Rohmetra,	Member
	Executive Editor, Daily Excelsion	
(V)	Mr. Bashir Ahmad Bashir,	Member
	Editor, Srinagar Times	
(VI)	·	Member
	Aaj Tak, President Press Club, Jammu	
(VII)	Mr. Mudassar Ali, Greater Kashmir	Member
(VIII)	Mr. Nitin Kanotra, Hindustan Times	Member
(IX)	Mr. Tauseef Mustafa, AFP	Member
(X)	Mr. Pawan Chowdhary, ABP News	Member
\	,	
(XII)	Mr. Sheikh Tariq, NDTV	Member

By order of the Government of Jammu and Kashmir.

(XII) Deputy Director Information, (PR)

(Sd.) B. B. VYAS, IAS,

Member-Secretary.

Principal Secretary to Government, Information Department.



JAMMU AND KASHMIR GOVERNMENT GAZETTE

PART II—A

Orders by Heads of Departments.

óóóóóó

CHARGE REPORTS

In pursuance to Government Order No. 1386-GAD of 2015 dated 19-10-2015, we the undersigned do hereby handover and takeover the charge of Director, Floriculture, Kashmir today on 21-10-2015 afternoon.

(Sd.) RAVINDER KUMAR, IAS.

Relieved Officer.

(Sd.) TALAT PARVEZ IQBAL ROHELLA, KAS.

Relieving Officer.

óóóóóó

Pursuant to Government Order No. 1386-GAD of 2015 dated 19-10-2015 issued under endorsement No. GAD (Ser) IAS/67/2012 dated 19-10-2015, we have in the afternoon of 20th of October, 2015 respectively made over and received charge of the Custodian General, J&K Government, Srinagar.

Station: Srinagar.

Dated: 20th of October, 2015.

(Sd.) SHAHID ANAYATULLAH, IAS.

Relieved Officer.

(Sd.) MOHAMMAD JAVED KHAN, IAS.

Custodian General.

Relieving Officer.



JAMMU & KASHMIR GOVERNMENT GAZETTE

PART II—B

Notifications, Notices and Orders by Heads of Departments.

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE DEPUTY COMMISSIONER, JAMMU.

Subject :ô Decaration under sections 06&07 of Land Acquisition Act, Svt. 1990 for land measuring 125 Kanals situated at Village Najwal, Tehsil Pargwal for construction of Border Fencing (135 Feet Wide Strip).

óóóóóóó

Notification No. 04/DCJ of 2015-16.

Whereas, the land whose specifications are given below is needed for public purpose i. e. for construction of Border Fencing (135 Feet Wide Strip) situated at Village Najwal Tehsil Pargwal, District Jammu:

District	Tehsil	Village	Kh. Nos.	Area
			óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	
1 -	2 δόδοδοδοδοδοδο	3 άδάδαδοδοδοδοδο	4 5666666666666666666666666666666666666	5 όδόδόδος
				K. M.
Jammu	Pargwal	Najwal	622	01ó14
			623	01ó16
			624	00ó14
			625	00ó15
			626	00ó19
			627	00ó17
			628	01ó14
			634	00ó15
			667	05ó14
			670	00ó12
			671	04ó15
			672	03ó16
			687	00ó04
			688	01ó04
			689	01ó16
			690	00ó19
			691	01ó18
			692	01ó10
			693	00ó06

1 2	3 66666666666666	4 666666666666666666666666666666666666	5 666666666666666666666666666666666666
		695	00617
		696	02602
		697	01600
		698	00ó08
		699	03605
		700	04ó10
		702	02ó18
		703	01613
		705	00ó14
		706	00619
		707	01614
		708	01610
		709	01613
		722	01610
		723	01615
		725	01602
		727	00ó16
		728	01602
		729	01607
		730	03600
		737	02612

	K. M.
738	01607
741	01610
742	04602
743	01602
744	01602
745	01604
746	01610
748	00617
749	01607
751	00ó14
761	02617
762	01610
763	02609
764	01613
766/1	01ó04
767/1	01602
768	01615
769	01618
774	02612
775	02606

		K. M.
779		02ó15
780		02612
955		01605
957		01609
962		00614
963		00611
965		01607
969		01602
970		00607
971		01615
972		03617
967		04ó13 óóóóóó
	Total	125600
		óóóóóó

Whereas, notification as required under section 4 (1) of the Land Acquisition Act, 1990 Svt. was issued by the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour vide his endorsement No. SDM/K/2015/122 dated 13-04-2015;

Whereas, the undersigned duly authorized by the Government vide SRO-235 and 236 of 2009 dated 11-08-2009 to exercise the powers under sections 6&7 of the Land Acquisition Act, 1990 (Svt.) is satisfied after considering the report furnished by the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour vide letter No. SDM/K/2015/350 dated 16-05-2015 that the land is required for public purpose viz. for construction of Border Fencing (135 Feet Wide Strip) situated at Najwal, Tehsil Pargwal.

Now, therefore, it is declared under section 6 of the said Act that the aforementioned land is needed for public purpose.

Further, the Collector, Land Acquisition, Sub-Divisional Magistrate, Khour is directed under section 7 of the said Act to take order for acquisition of the land of which specifications are given above and complete further proceedings under due process.

(Sd.) SIMRANDEEP SINGH, IAS,

Deputy Commissioner, Jammu.

όόόόόόό

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE ASSISTANT COMMISSIONER, REVENUE (COMPETENT AUTHORITY), KATHUA.

Corrigendum

Subject :ô Correction of area regarding :ô The correction of area and kind of land in the Notification No. 50 dated 15-11-2014, issued under endorsement No. DCK/LHS/2014-15/1138-48 dated 15-11-2014 in respect of land situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua (The total area increased by 01Kl).

óóóóóóó

The land measuring 72Kls-16 Mls situated at Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua was notified vide this office Notification No. 50 dated 15-11-2014, issued under endorsement No. DCK/LHS/2014-15/1138-48 dated 15-11-2014 under sub-section (1) of section 3 of the Jammu and Kashmir Underground Public Utilities (Acquisition of Rights of User in Land) Act, 2014 for the purpose namely underground laying of gas pipelines or any other utility. In this notification, the total area may be read as 73Kl-16 Ml instead of 72Kl-16 Ml, (Increased = 01 Kl having kind of soil Gair Mumkin) situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua.

The total area under acquisition of rights of user in land shall be read notified as 73 Kl-16 Ml instead of 72Kl-16 Ml, situated in Village Muthi Hardoo, Tehsil Hiranagar presently Tehsil Marheen, District Kathua.

The kind-wise breakup of land is given as :ô

Kind of land

	Nehri	Banjar Qadeem	Gari Mumkin	Area
Note :ô	óóóóóóóó	óóóóóóóóóóóóóóó	óóóóóóóóóóóóó	όόόόόόόόό <i>ό</i>
	K. M.	K. M.	K. M.	K. M.
	55-111/2	01-03	17-01½	73-16

(Sd.) ATUL GUPTA, KAS,

Assistant Commissioner, Revenue (Competent Authority), Kathua.

όόόόόόό

IN THE COURT OF ADDITIONAL SPECIAL MOBILE MAGISTRATE, BATALIK/DRASS.

Present: Tsewang Phuntsog.

State through PS. Drass V/s. 1. Abdul Jabbar S/o Mohd. Sharif R/o Nera, Ramban, Jammu

> 2. Ranjit Singh S/o Amar Singh R/o Sumbul Mode, R. S. Pora, Jammu

Case FIR No. 29/2010, PS, Drass under sections 341, 323 RPC.

General Warant of Arrest

To

Director General of Police, J&K Police.

In the above titled case, the accused Abdul Jabbar has not been causing his appearance before this Court since long. This Court is satisfied that the

Issued under my hand and Seal of the Court.

(5	(d.)	١.																														
1~	,	•	٠	• •	٠.	•	•	•	•	۰	•	•	•	٠	٠	٠	٠	٠	•	• •	 •	۰	•	۰	•	۰	•	٠	•	•	•	۹

Munsiff Additional Special Mobile Magistrate, Batalik/Drass.

óóóóóóó

BEFORE THE HONØBLE COURT OF PRINCIPAL SESSIONS JUDGE, SRINAGAR.

Present :ô Rashid Ali Dar.

State through Police Station, V/s. Kothibagh

Mohammad Shafi Bhat S/o Gh. Mohammad Bhat R/o Kursoo Raj Bagh, Srinagar

Case FIR No. 36/2002 and 56/2002 under sections 420, 467, 471 RPC of P/S, Kothibagh.

Proclamation under section 87 Cr. P. C.

Whereas, the criminal cases cited above are pending disposal before this court with charge of the criminal offences against the accused;

Whereas, in view of the continuous absence of the accused and flouting of the terms and conditions of the bail, proceedings under section 514 Cr. P. C. have already been initiated against the accused;

Whereas, presence of the accused could not be procured as the accused is concealing himself to avoid the attendance before the Court.

Proclamatin is hereby made that the said accused Mohammad Shafi Bhat is required to appear before the Court of the undersigned on 09-11-2015 at 10.30 am to be examined touching the veracity of the challan.

(Sd.)	

Principal Sessions Judge, Srinagar. óóóóóóó

NOTICE FOR GENERAL PUBLIC

The candidate whose particulars are mentioned below is claiming to have lost/gutted his Original and as well as Duplicate Qualification Certificate/s issued by J&K State Board of School Education, under serial Nos. 207 and 1189 respectively, with following particulars:ô

1.	Name	Tej Krishan
2.	Parentage	Pt. Madue Lal Dhar
3.	Residence	Langate Handwara, District Kupwara
4.	Date of Birth	20-04-1958
5.	Roll No.	434
6.	Session	1973, March
7.	Result	Passes

Now, the candidate has applied for õ2nd Duplicate Qualification Certificateö. Before, the same is processed and provided to the concerned candidate, any person/s having any objections in this regard, may please file the same before the Secretary, BOSE or to the undersigned within a period of seven days from the date of issue of this notice

Besides, the above referred õboth Qualification Certificatesö be treated as cancelled.

(Sd.)	
	Assistant Secretary Certificates, K. Div

My name and my father an ame has wrongly been written as Rajinder Gupta instead of Rajinder Prashad Resutra and Karam Chand Kasotra instead of Karam Chand Resutra in my PAN Card bearing No. AHQPRO 717E. Now, I am applying for correction. Objection, if any, may be conveyed to concerned authority within 7 days.

Rajinder Prashad Resutra,

S/o Karam Chand Resutra, R/o Plot 38, Sarwal Colony, Jammu.

óóóóóóó

Correction

I, Megha D/o Shri Chaman Lal Shivgotra R/o H. No. 333, Sector-1/A, South Extn., Trikuta Nagar, Jammu appliying for the correction of my name which has been wrongly written as Megha Shivgotra in Union Public Service Commission, Combined Medical Services Examination, 2015, bearing Roll No. 002675. Now, the correct name is Megha. Objection, if any, may be conveyed to UPSC Shahjahan Road, Dholpur House, New Delhi-110069. That Megha and Megha Shivgotra is the name of one and the same person. That I do not intend to add my surname with my name in future.

όόόόόόό

Notice

The name of my Child in his School Record i. e. Army Public School, Domana (Barnai), Jammu is written as Vikas Thapa whereas his correct name is Vikas Thappa S/o Shiv Ram R/o Village Jungwari, P/O Domana, Tehsil and District Jammu. Objection in this regard, if any, be sent to school authorities within 7 days of this notice.

Shiv Ram, F/o Vikas Thappa, R/o Jungwari, Domana, Jammu.



THE JAMMUAND KASHMIR GOVERNMENT GAZETTE

ADVERTISEMENT-C

HEADQUARTERS OF HOMEGUARDS/CIVIL DEFENCE AND SDRF, J&K, SRINAGAR.

e-NIT No. 02 of 2015

Dated 19ó10ó2015.

For and on behalf of the Governor of Jammu and Kashmir, e-Tenders in two cover system (Technical and Financial Bid) are hereby invited from

The tenders (technical bids only) will be opened online on 0261262015 at 1100 hours at Police Headquarters, Gulshan Ground, Gandhi Nagar, Jammu. In case of unforeseen circumstances, the date of opening will be next working day.

Detailed tender documents (SBD) with terms and conditions are available on J&K State e-Procurement Portal www.jktenders.gov.in.

(Sd.)																							
١	Du.	, .	•	•	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠	٠

Addl. Director General of Police, HG/CD & SDRF, J&K, Srinagar.

óóóóóóóó

HEADQUARTERS OF HOMEGUARDS/CIVIL DEFENCE AND SDRF, J&K, SRINAGAR.

e-NIT No. 03 of 2015

Dated 19ó10ó2015.

For and on behalf of the Governor of Jammu and Kashmir, e-Tenders in two cover system (Technical and Financial Bid) are hereby invited from original manufacturers/authorized dealers having specific authorization from

The tenders (technical bids only) will be opened online on 0261262015 at 1100 hours at Police Headquarters, Gulshan Ground, Gandhi Nagar, Jammu. In case of unforeseen circumstances, the date of opening will be next working day.

Detailed tender documents (SBD) with terms and conditions are available on J&K State e-Procurement Portal www.jktenders.gov.in.

	(Sd.)
Addl. Dire	ector General of Police HG/CD & SDRF J&K, Srinagar
óóóóóóóó	
GOVERNMENT OF JAMMUAN DIRECTORATE GENERAL, FIRE AND EMER J&K, JAMMU.	
Extension Notice It is notified for the information of all concu	

Period of downloading From 1061162015 to 2061162015

Date of submission of online

documents

Up to 20ó11ó2015

Date of submission of Hard Copy Up to 216116201 up to 4.00 P. M.

Date of opening tenders 23ó11ó2015 or any other

convenient date

Other terms and conditions of the NIT shall remain unchanged

(Sd.)

Accounts Officer, Fire and Emergency Services, J&K, Jammu.

óóóóóóó

POLICE TELECOM. HEADQUARTERS J&K, JAMMU.

NIT No. 03 of 2015

Dated 17ó11ó2015.

1. Sealed tenders affixed with revenue stamp of Rs. 5/- are hereby invited for the supply of Data Paper of below mentioned specifications :66

Computer Data Paper 80 Col. (80) Col. Part-1, 60 GSM Dimensions 25.4 cm x 30.5 cm (1000 sheets in each packet).

2. Tenders are to be submitted on prescribed tender form which can be obtained on application from the Office of Police Telecom. Headquarters, J&K, Jammu, 1st Floor, APHQ Complex, Gulshan Ground, Jammu on payment of tender fee of Rs. 500/- in cash or money order which will not

- 3. Intending tenderers shall furnish the tender in two parts (technical bid and financial bid). Each bid shall be in separate envelop duly superscripted as tender bid and financial bid, along with name of tenderer, NIT No. and date. Sealed envelope containing technical bid and financial bid shall then be placed in one cover which shall be duly sealed and superscripted giving NIT No., date and name of tenderers and should reach this office on or before 08-12-2015 up to 1030 hrs. The technical bid will be opened on 09-12-2015 at 1500 hrs. in the Office of Director, Police Telecom., J&K, Jammu in presence of intending tenderers who may choose to be present. In case of unforeseen circumstances the date of opening of tenders received will be next working day. Financial bid shall be opened only of those tenderers who qualify technically as per serial No. 04 of this notice.
 - 4. Part 1st technical bid shall containóó
 - (a) Sample of 10 pages of Data Paper which is must showing make of Data Paper on each or on alternate page.
 - (b) Earnest money in shape of CDR/FDR only.
 - (c) A copy of this NIT affixed with revenue stamp of Rs. 5/- duly signed and stamped on every page by the tenderers in token of having understood and accepted the specifications, terms and conditions of the NIT.
 - (d) CST certificate.
 - (e) VAT clearance certificate up to March, 2015.
 - (f) A certificate that quoted rates are minimum and not above MRP as applicable to Government Department.
 - 5. Part 2nd financial bid shall containóó
 - (a) Basic unit rate (inclusive of taxes).
 - (b) Make of data paper.
- 6. Intending tenderers shall have to deposit earnest money of Rs. 25,000/- in the form of CDR/FDR pledged to Staff Officer (SSP), IGP,

- 7. Tenders received after the prescribed time and date will be rejected.

For and on behalf of the Governor.

(Du.)	(Sd.)																
-------	-------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

Staff Officer SSP (DDO) For Inspector General of Police, Telecom., J&K, Jammu.

SUPPLEMENTARY-C

óóóóóóó

GOVERNMENT OF JAMMU AND KASHMIR, OFFICE OF THE GENERAL MANAGER, RANBIR GOVERNMENT PRESS, JAMMU (TAWI)-180005.

Short Term Tender Notice

Sealed tenders affixed with revenue stamps worth Rs. 5/- are invited from the interested parties/registered private firms for the rate contract of õRaw Material for Fabrication of Wall Calendar/Engagement Pad for the year 2016ö as per below mentioned specifications. The quotation should reach in this office of the undersigned by or before 05-12-2015 up to 12.00 Noon and shall be opened on the same day or any other date convenient to the Unit Purchase Committee of the department :66

S. No. Items Required Material with Quantity
Specification (Approx.)

- 1. Wall Calendar (i) õWire-o-Wireö Size 6 mm
 - Size 15"x 20" (ii) Hanger (Metallic) Size 15" comprised of 3 lvs.
- 2. Engagement Pad õWire-o-Wireö Size 22 mm 15,000 Nos. Size 6½"x10" comprised of 54 lvs.

Terms and Conditions:

- 1. The tenderers are advised to furnish earnest money of Rs. 1,000/- in the shape of CDR/FDR duly pledged to the General Manager, Ranbir Govt. Press, Jammu.
- 2. The rates are FOR Press included all taxes and charges.
- 3. Supply of material shall be made within 10 days from the date of placement of supply order .

For and on behalf of the Governor of Jammu and Kashmir.

(Sd.) F. H. QADRI,

16,000 Nos.

General Manager.

عمیمه جمعیت عمیمه عم



رجٹر ڈنمبر ہے کے۔33

جمُّو الصَّمْبِرُكُورِثَمْنُ طُّ كُرْ طُ

جلد نمبر 128_ جمول مورخه 3 ومبر 2015ء بمطابق 12 اگراهنا 37 وروار نمبر 36

إشتهارات

ازعدالت چیف جوڈ بیثل مجسٹریٹ کھوعہ سرکار بنام بلبیر سنگھ وغیرہ

مثل نمبر 121 / جالان، تاریخ دائره 2010-07-21

بذريعه علت نمبر 202 سال 2010ء، تقانه پوليس كھنور

جرائم زير دفعات : 341,324/323 RPC

وارنٹ گشتی عام زیرد نعہ 512 ض ف ہرخاص وعام

بخلاف ملزم: بلبیر سنگه عرف پمال ولد بوگراج ساکنه چک پرتاپ سنگه مخلاف ملزم: مبلی مور مختصیل وضلع کشوعه

حُكم بنام: المكاران يوليس رياست جمول وكشمير

مقدمه مندرجه عنوان ألصدر مين ملزم كافي عرصه سے غير حاضر عدالت

چلاآر ہاہے اور سردست دستیابی کی کوئی اُمیدنہ ہے۔

لہٰذا آپ کوشکم دیاجا تاہے کہ ملزم مٰدکور جہاں کہیں بھی دستیاب ہو،کوگر فنار کر کے روبر دعدالت مٰذا پیش کریں۔وارنٹ مٰذا تا دستیا بی ملزم زیر کارر ہے گا۔

08-06-2015 : يَرِّعُ

وستخط: چيف جوڙيشل مجسر بيك كھوعه۔

از عدالت فسط ایر نیشنل سیشن جج جمول سرکار بنام وین کماروغیره

مثل نمبری سیش /74، دائره 2006-03-28

تاريخ كارروائي 2015-11-10، آئنده تاريخ بيشي 2015-12-28

علت نمبر 75سال2005ء ، تھانہ پولیس نوآباد

427/435/447/34 RPC : جرائمُ زير دفعات

وارنٹ گشتی عام زردنعہ 512 ض

بخلاف ملزم: وِ بِن كما رعرف بهوت ولدرومیش كما رسا كنه مكان نمبر 349، لین نمبر 6 شکتی نگر جمول -

حُكم بنام : المكاران بوليس رياست جمول وتشمير

مقدمه مندرجه عنوان ألصدر میں ملزم مذکور ہ عرصہ دراز سے دستیاب نہ

ہور ہاہے۔

البذابذربعه وارنٹ گشتی مذاحگم واختیار دیا جاتا ہے کہ آپ ملزم مذکور جہال کہیں بھی اندر حدود ریاست جمول و کشمیر دستیاب ہو، کو گرفتار کر کے روبر وعدالت پیش کریں ۔ وارنٹ مذاتا دستیاب ملزم مذکور زیر کارر ہے گا۔
آج تاریخ 10 ماہ نومبر سال 2015ء ہمارے دستخط و مہر عدالت سے جاری ہوا۔

سركار بنام وين بعوت وغيره

مثل نمبری سیشن/5، تاریخ دائرہ 2015-05-20-20-20-20 مثل نمبری سیشن/5، تاریخ دائرہ 2015-20-20-28 تاریخ بیشی 2015-12-28 علت نمبر231 سال 2003ء تھانہ پولیس با ہوفورٹ

180 - جمول وكشمير كورنمنث كزث نبر 36 مورخه 3 وتمبر 2015 ء بمطابق 12 اگراهنا 1937 ضميمت

. جرائم زير دفعات 307/341/34 RPC 4 / 25, A. Act

وارنٹ گشتی عام زیردنعہ512ض

بخلاف ملزم: وِ پِن بھوت ولدرومیش چندرقوم مہاجن ساکندمکان نمبر 349/6 شکتی نگر جموں حُکم بنام : اہلکاران پولیس ریاست جموں وکشمیر۔

مقدمه مندرجه عنوان ألصدر ميں ملزم مذكور ه عرصه دراز سے دستياب

نہ ہور ہاہے ۔

الهذا آپ کوبذر بعد وارنٹ گشتی مذاطکم واختیار دیا جاتا ہے کہ آپ ملزم مذکور جہاں کہیں بھی اندر حدود ریاست جموں وکشمیر دستیاب ہو،کوگرفتار کر کے روبروپیش کریں۔وارنٹ مذاتا دستیا بی ملزم مذکور زیر کارر ہے گا۔

آج تاریخ 10 ماہ نومبر سال 15 20ء ہمارے دستخط ومہر عدالت سے حاری ہوا۔

وستخط: فسط ایدیشنل سیشن جج جمول _

0+0+0+0+0+0



THE

JAMMU & KASHMIR GOVERNMENT GAZETTE

PART III

Laws, Regulations and Rules passed thereunder.

ôôôó

JAMMU AND KASHMIR
STATE ELECTRICITY REGULATORY COMMISSION
(GRID INTERACTIVE ROOFTOP SOLAR PHOTO VOLTAIC
SYSTEMS BASED ON NET METERING) REGULATIONS, 2015

Notification No. 47-JKSERC of 2015

Dated 15-10-2015.

In exercise of powers conferred under section 138 read with sections 55, 60 and 71(1) (e) of the J&K Electricity Act, 2010 (Act XIII of 2010) and all other powers enabling it in this behalf, the Jammu and Kashmir State Electricity Regulatory Commission hereby makes the following Regulations for Grid Connected Rooftop Solar Photo Voltaic (SPV) Systems based on Net Metering.

- 1. Short title and commencementóó
 - 1.1 These Regulations may be called the Jammu and Kashmir State Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015, in short, JKSERC Net Metering Regulations, 2015.
 - 1.2 These Regulations shall come into force from the date of publication of the same in the Government Gazette.
- 2. Definitions and interpretationóó
 - 2.1 In these Regulations, unless the context otherwise requires,óó
 - (a) õActö means the Jammu and Kashmir Electricity Act, 2010 (Act XIII of 2010), as amended from time to time;
 - (b) õAgreementö means an agreement signed by the distribution licensee with the eligible consumer for net metering arrangement ;
 - (c) õBilling Cycleö or õBilling Periodö means the period for which regular electricity bills as specified by the Commission are issued by the distribution licensee to different categories of consumers;
 - (d) õCommissionö means the Jammu and Kashmir State Electricity Regulatory Commission ;
 - (e) õConnected Loadö means the sum of the rated capacities in KW/HP of all energy consuming including portable apparatus duly wired and connected to the power supply system in the consumerøs premises. However, this shall not include the load of extension plug sockets, standby or spare

energy consuming apparatus, installed through change over switch, which cannot be operated simultaneously and any other load exclusively meant for fire-fighting purposes. In case of domestic consumers, load of geysers plus heaters or of air conditioners without heaters, whichever is higher, is to be considered. Any equipment which is under installation and not connected electrically, equipment stored in warehouse/showrooms either as spare or for sale is not to be considered as part of the connected load;

- (f) õConsumerö means any person who is supplied with electricity for his own use by a licensee or the Government or by any other person engaged in the business of supplying electricity to the public under the Act or any other law for the time being in force and includes any person whose premises are for the time being connected for the purpose of receiving electricity with the works of distribution licensee, the Government or such other person, as the case may be ;
- (g) õContract Demandö or õContracted Loadö means the maximum demand (in kW, kVA or BHP units) contracted by the consumer in Agreement with the Licensee. The contract demand cannot be reduced to less than 60% of the sanctioned/connected load;
- (h) õDistribution Licenseeö or õLicenseeö means a person granted a licence under section 14 of the Act and authorized to operate and maintain a distribution system for supplying electricity to the consumers in his area of supply and includes J&K Power Development Department;

- - (i) õEligible Consumerö means a consumer of electricity in the area of supply of distribution licensee, who uses a rooftop SPV System installed in his premises to offset part or all of the consumerøs own electrical requirements, given that such systems can be iself ownedø or ithird party ownedø;
 - (j) õFinancial Yearö or õYearö means period beginning from first day of April and ending with thirty first day of March of next year;
 - (k) õInterconnection Pointö means the interface of rooftop solar power generation facility under net metering arrangements with the network of distribution licensee and shall normally be the point where net meter is installed;
 - (l) õInvoiceö means the monthly bill or a supplementary bill or a monthly invoice or a supplementary invoice raised by the distribution licensee to the consumer;
 - (m) õkWpö means kilo Watt peak;
 - (n) õNet Meteringö means an arrangement under which rooftop SPV System installed at eligible consumer premises delivers surplus electricity, if any, through net meter to distribution licensee for offsetting the electricity supplied by distribution licensee during the applicable or subsequent billing period but within settlement period;
 - (o) õObligated Entityö means the entity mandated by the Commission under clause (e) of sub-section (1) of section 71 of the Act to fulfill the renewable purchase obligation and identified under JKSERC (Renewable Purchase Obligation, its compliance and

- - (p) õPremisesö means rooftops or/and elevated areas on the land, building or infrastructure or part or combination thereof in respect of which a separate meter or metering arrangement have been made by the distribution licensee for the supply of electricity;
 - (q) õRenewable Energy Certificateö (REC) means the certificate issued in accordance with the procedures prescribed in Central Electricity Regulatory Commission (Terms and Conditions for recognition and issuance of Renewable Energy Certificate for Renewable Energy Generation) Regulations, 2010 as amended from time to time;
 - (r) õRooftop Solar Systemö means the Solar Photo Voltaic System installed in the premises of the consumer that uses solar energy for direct conversion into electricity through photo voltaic technology;
 - (s) õSanctioned Loadö means the load in kW, kVA or BHP, which the Licensee has agreed to supply from time to time subject to the governing terms and conditions. The total Connected Load is required to be sanctioned by the competent authority;
 - (t) õSettlement Periodö means the period beginning from first day of April of a year and ending with thirty first day of March of next year;
 - (u) õSolar Meterö means a unidirectional energy meter installed as an integral part of the net metering

system at the point at which electricity generated by Solar Photo Voltaic (SPV) System, is delivered to the main panel of eligible consumer;

- (v) õState Agencyö means the agency as designated by the Commission under Regulation 9 of the JKSERC (Renewable Power Purchase Obligation, its compliance and REC Framework Implementation) Regulations, 2011;
- (w) õSupply Codeö means the Jammu and Kashmir State Electricity Regulatory Supply Code, 2011, as amended from time to time;
- (x) õTariff Orderö in respect of a licensee means the Order issued by the Commission for the relevant year for that licensee indicating the rates to be charged by the licensee from various categories of consumers for supply of electrical energy and for other services;
- (y) õThird Party Ownerö means a developer who is generating solar energy on a rooftop but does not own the rooftop, and who also enters into a lease/ commercial agreement with the rooftop owner.
- 2.2 (a) All other words and expressions used in these regulations although not specifically defined hereinabove, but defined in the Act, shall have the meaning assigned to them in the Act;
 - (b) All other words and expressions used herein but not specifically defined in these regulations or in the Act but defined under any other law passed by the State Legislature or Regulations framed under the Act,

shall have the meaning assigned to them in such Law/Regulations.

- 2.3 Abbreviations used in these Regulations shall have the meanings as stated in (Annexure-I).
- 3. Scope and applicationóó
 - 3.1 These Regulations shall apply to distribution licensee and consumers of such distribution licensee in the State of Jammu and Kashmir.
 - 3.2 Any consumer in the area of supply of distribution licensee may install rooftop solar system under net metering arrangement whichóó
 - (a) Shall be of minimum 1 kWp and up to 1 MWp (AC side) capacity with or without battery backup support;
 - (b) Shall be located in the consumer premises;
 - (c) Shall interconnect and operate safely in parallel with the distribution licensee's network.
 - 3.3 These regulations do not preclude the right of any person to undertake rooftop solar projects above 1 MWp capacity through alternative mechanism.
 - 3.4 The net metering facility shall also be applicable to such consumers who have installed rooftop solar system before commencement of these regulations subject to compliance of these regulations.
- 4. General conditions.óóThe distribution licensee shall offer the provision of net metering arrangement to the eligible consumer, who

Provided, the consumer is eligible to install the grid connected rooftop solar system of the rated capacity as specified in these regulations :

Provided further that the distribution licensee shall offer the provision of net metering to the consumer for the target capacity as specified in these regulations:

Provided also that the interconnection of such system with the grid is undertaken as specified in CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013, as amended from time to time:

Provided also that the distribution licensee shall accept the SPV power as per the useful life of the SPV System as per CERC Regulations.

- 5. Capacity target for distribution licenseeóó
 - 5.1 The distribution licensee shall provide net metering arrangement to eligible consumers as long as the total capacity (in MW) of rooftop solar systems does not exceed the target capacity determined by the Commission:

Provided that initially, a maximum cumulative capacity to be installed by eligible consumers under net metering in the area of supply of each distribution licensee shall be as decided by the Commission. Thereafter, the target capacity shall be reviewed on yearly basis by the Commission:

Provided further the cumulative capacity of rooftop solar system to be allowed to a particular distribution transformer shall not exceed 20% of the rated capacity of the distribution transformer.

- 5.2 The distribution licensee shall provide information regarding distribution transformer level capacity available for connecting rooftop solar system under net metering arrangement within six (6) months from the date of notification of these regulations. The distribution licensee thereafter shall update the distribution transformer level capacity available and the cumulative capacity of the rooftop solar systems installed under net metering arrangement on yearly basis by 30th April and shall provide the information on its website as well as to the Commission.
- 6. Eligible consumer and individual project capacityóó
 - 6.1 All eligible consumers of electricity in the area of the supply of distribution licensee can participate in the solar rooftop net metering arrangement subject to target capacity.
 - 6.2 The maximum capacity of rooftop solar system shall not exceed 50% of the sanctioned load of the consumer (for kVA conversion to kW use a power factor of 0.9):

Provided that the installed capacity shall not be less than 1 kWp and shall not exceed 1MWp (AC side) for a single eligible consumer :

Provided further that a variation in the rated capacity of the system within a range of five per cent shall be allowed.

- 7. Procedures for application and registrationóó
 - 7.1 The Eligible Consumer who proposes to install a solar energy system in his premises shall apply in the application form (Annexure-II), which the distribution

licensee shall notify on its website as downloadable as well as make available at the relevant sub-divisional office of the distribution licensee along with the application/processing fee of Rs. 100/kW subject to a maximum of Rs. 10,000.

- 7.2 The licensee shall acknowledge the receipt of the application form and register the application and shall process the application in the order of the receipt.
- 7.3 Within fifteen (15) working days of receipt of the Eligible Consumerøs application, the distribution licensee shall provide written notice that it has received all documents required by the standard interconnection agreement or indicate how the application is deficient.
- 7.4 The Distribution Licensee shall assess the feasibility and intimate the same to the Eligible Consumer within thirty (30) days from the receipt of completed application. The feasibility shall be valid for a period of six months, unless extended by the Distribution Licensee:

Provided that if the Distribution Licensee determines that an interconnection study is necessary as per sub-regulation 7.5, the Distribution Licensee shall intimate feasibility or otherwise within sixty (60) days from the receipt of completed application.

- 7.5 While intimating the feasibility for the connection of Rooftop PV Solar Power Plant as specified in sub-regulation 7.4, the Distribution Licensee shall also intimate the Eligible Consumeróó
 - (a) The details of documents to be submitted by the Eligible Consumer;
 - (b) Particulars of any deficiencies, if noticed, along with instructions to remove such defects;
 - (c) Details of any interconnection study required.

7.6 The Distribution Licensee shall, on receipt of the report on removing defects, if any, and the documents submitted under sub-regulation 7.5, convey the approval within ten (10) working days from the date of receipt:

Provided that if the deficiency as per sub-regulation 7.5 is not removed by the Eligible Consumer within sixty (60) days from the date of receipt of such intimation to the Eligible Consumer, the application shall stand cancelled and the application/processing fee shall be forfeited.

- 7.7 The interconnection agreement (Annexure-III) shall be executed by the distribution licensee with the eligible consumer within thirty (30) days of the accord of approval under Regulation 7.6.
- 8. Interconnection with the Grid, Standards and Safetyóó
 - 8.1 The interconnection of the Rooftop PV Solar Power Plant with the network of the distribution licensee shall be made as per the technical specifications and standards for connectivity provided in the Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013, as amended from time to time.
 - 8.2 The connectivity levels at which the Rooftop PV Solar Power Plants shall be connected with the grid are as specified below :óó
 - S. Connected load of Connectivity level No. Eligible Consumer
 - 1. Up to 5 kW 240 V-single phase
 - 2. Above 5 kW and 415 V-three phase up to 100 kW
 - 3. Above 100 kW HT/EHT level

- 8.3 The above connectivity norms are applicable to all the solar power generators who seek connectivity with network of the distribution licensees. EHT/HT consumers may install solar power generators at LT/HT voltage and connect them to their LT/HT system.
- 8.4 In the interconnection of rooftop PV solar energy generator with the local distribution licensee¢s grid, the relevant provisions of the Central Electricity Authority (Measures relating to Safety and Electric Supply) Regulations, 2010 as amended from time to time shall apply.
- 8.5 The solar energy generator shall be responsible for safe operation, maintenance and rectification of defect of its system up to the interconnection point beyond which the responsibility of safe operation, maintenance and rectification of any defect in the system including the net meter shall rest with the distribution licensee.
- 8.6 The consumer shall be solely responsible for any accident to human being/animals, whatsoever, (fatal/nonfatal) that may occur due to back feeding from the Solar Plant when the grid supply is off. The distribution licensee reserves the right to disconnect the consumer in installation at any time in the event of such exigencies to prevent accident or damage to man and material.
- 8.7 The tests as per distribution licenseeøs standards shall be done to ensure the quality of power generated from the Solar PV Systems.
- 8.8 Any alternate source of supply shall be restricted to the consumer source of supply shall be responsible to take adequate safety measures to prevent

battery power/diesel generator power/backup power extending to distribution licenseeøs LT grid on failure of distribution licenseeøs grid supply.

- 8.9 The distribution licensee shall have the right to disconnect the rooftop PV solar energy generator from its system at any time in the following conditions :óó
 - i. Emergencies or maintenance requirement on the distribution licensee¢s electric system;
 - ii. Hazardous condition existing on the distribution licensee@s system due to operation of solar energy generator or protective equipment as determined by the Distribution Licensee/Transmission Licensee/SLDC.
 - iii. Adverse electrical effects, such as power quality problems, on the electrical equipment of the other consumers of the distribution licensee caused by the solar energy generation as determined by the distribution licensee.
- 8.10 Subject to sub-regulation 8.5 above, the distribution licensee may call upon the rooftop PV solar energy generator to rectify the defect within a reasonable time.
- 8.11 The Rooftop PV Solar Power Plant should be capable of detecting an unintended islanding condition. These systems must have anti-islanding protection to prevent any unfavorable conditions including failure of supply. IEC-62116 shall be followed to test islanding prevention measure for grid connected photovoltaic inverters.
- 8.12 Every Rooftop PV Solar Power Plant shall be equipped with automatic synchronization device :

Provided that Rooftop PV Solar Power Plant using inverter shall not be required to have separate

- - 8.13 The Rooftop PV Solar Power Plant operating in parallel with electricity system shall be equipped with the following protective functions to sense abnormal conditions on electricity system and cause the Rooftop PV Solar Power Plant to be automatically disconnected from the electricity system or to prevent the Rooftop PV Solar Power Plant from being connected to electricity system inappropriately:óó
 - i. Over and under voltage trip functions if voltage reaches above 110% or below 80% respectively with a clearing time up to two seconds; however, appropriate licensee may prescribe a narrower range of voltage for the purpose;
 - ii. Over and under frequency trip functions, if frequency reaches 50.5 Hz or below 47.5 Hz with a clearing time up to 0.2 seconds; however, appropriate licensee may prescribe a narrower range of frequency for the purpose;
 - iii. The Rooftop PV Solar Power Plant shall cease to energize the circuit to which it is connected in case of any fault in this circuit.
 - iv. A voltage and frequency sensing and time delay function to prevent the Rooftop PV Solar Power Plant from energizing a de-energized circuit and to prevent the Rooftop PV Solar Power Plant from reconnecting with electricity system unless voltage and frequency is within the prescribed limits and are stable for at least sixty seconds; and

- v. A function to prevent the Rooftop PV Solar Power Plant from contributing to the formation of an unintended island, and cease to energize the electricity system within two seconds of the formation of an unintended island.
- 8.14 The equipment of the Rooftop PV Solar Power Plant shall meet following requirements, namely :óó
 - Circuit Breakers or other interrupting equipment shall be suitable for their intended application with the capability of interrupting the maximum available fault current expected at their location;
 - ii. The Rooftop PV Solar Power Plant and associated equipment shall be designed so that the failure of any single device or component shall not potentially compromise the safety and reliability of the electricity system;
 - iii. Paralleling device of the Rooftop PV Solar Power Plant shall be capable of withstanding 220% of the nominal voltage at the interconnection point.
- 8.15 Every time the Rooftop PV Solar Power Plant of the Eligible Consumer is synchronized to the electricity system, it shall not cause voltage fluctuation greater than ±5% at the point of interconnection.
- 8.16 After considering the maintenance and safety procedures, the distribution licensee may require a Rooftop PV Solar Power Plant to provide a manually operated isolating switch between the Rooftop PV Solar Power Plant and the electricity system, which shall meet following requirements:
 - i. Allow visible verification that separation has been accomplished;

- - ii. Include indications to clearly show open and closed positions;
 - iii. Be capable of being reached quickly and conveniently twenty four hours a day by licensee¢s personnel without requiring clearance from the applicant;
 - iv. Be capable of being locked in the open position;
 - v. May not be rated for load break nor may have feature of over-current protection; and
 - vi. Be located at a height of at least 2.44 m above the ground level.
 - 8.17. Prior to synchronization of the Rooftop PV Solar Power Plant for the first time with electricity system, the applicant and the appropriate licensee shall agree on the protection features and control diagrams.
 - 8.18 The power conditioning unit shall have the features of filtering out harmonics and other distortions before injecting the energy into the system of the distribution utility. The technical standards, power quality standards and inverter standards shall be as per (Annexure-IV) of these regulations or any other standards as may be specified by CEA from time to time.
- 9. Third Party Owned Rooftop Solar PV System based on net metering66
 - 9.1 The third party owned rooftop solar PV net metering model may consist of the developer or intermediaries leasing out solar PV system to interested rooftop owners. The owner of the premises provides the rooftop and engages a turnkey installer to design and install the system. The installers may also offer integrated service of leasing, commissioning and maintenance of Solar PV System to owners and guaranteeing standards of performance.

- 9.2 In the third party owned solar PV system based on net metering, the electricity generated from such plants/ system shall be used to meet the eligible consumerøs internal electricity needs, while the excess generation shall be fed into the Grid (network of licensee) on Net Metering basis.
- 9.3 The developer shall continue to be the owner of equipment in third party owned system, to qualify for claiming depreciation on capital cost for the solar PV system with associated direct tax benefits, if any.
- 9.4 For all intents and purposes, the distribution licensee shall deal with the consumer only and arrangement between rooftop owner and developer shall be personal to them.

10. Metering arrangementóó

- 10.1 The metering system shall be as per the regulations for installation and operation of meters for rooftop solar systems under net metering arrangement specified in these regulations.
- 10.2 The schematic arrangement for interconnection of Rooftop and Small PV Solar Power Plant with the Distribution Licensee's grid is shown at (Annexure-V). There shall be two meters. The metering arrangement shall be as per (Annexure-VI).
- 10.3 The bi-directional (net meter) shall be installed at the interconnection point of the Eligible Consumer with the network of the distribution licensee :

Provided that for the existing consumers, the consumer meter shall be replaced with the bi-directional/net meter :

Provided further that consumers having ABT compliant meters shall not be required to install additional net meter.

- 10.4 Solar meter shall be installed at the solar facility after the inverter to measure the solar generation.
- 10.5 These meters shall have the facility for downloading meter readings using Meter Reading Instrument (MRI). Check meters shall be mandatory for rooftop solar systems having capacity more than 250 kW. For installations size of less than and equal to 250 kW, the solar check meters would be optional:

Provided that the cost of new/additional meter (s) shall be borne by the Eligible Consumer and installed and owned by the distribution licensee:

Provided, if bills are prepared on the basis of MRI downloads or if meter reading is taken on the basis of remote meter reading and the consumer wishes to have a record of the reading taken, he shall be allowed so by the licensee.

10.6 The meters installed shall be jointly inspected and sealed on behalf of both the parties and shall be interfered/tested or checked only in the presence of the representatives of the consumer and distribution licensee or as per the supply code specified by the Commission:

Provided that the Eligible Consumer shall follow the metering specifications and provisions for placement of meter as developed by the distribution licensee from time to time and as per the supply code:

Provided further that in case the Eligible Consumer is under the ambit of time of day (TOD) tariff, meters compliant of recording time of day consumption/generation shall be employed.

- 10.7 The meter readings taken by the distribution licensee shall form the basis of commercial settlement.
- 10.8 The technical standards for meters shall be as per (Annexure-VII) and shall comply with the standards specified by CEA from time to time.
- 10.9 The meters installed for Rooftop PV Solar Power Plants with capacity above 250 kWp shall have the communication port for exchanging real time information with Distribution Licensee.

11. Energy Accounting and Settlementóó

- 11.1 The accounting of the electricity generated, consumed and injected by the rooftop solar system under these regulations shall become effective from the date of connectivity of such system with the network of distribution licensee.
- 11.2 The procedure for billing and energy accounting shall be as underóó
 - (a) For each billing cycle the consumer shall receive an energy account statement showing quantum of electricity injected by the eligible consumer in the billing period, electricity supplied by the distribution licensee in the billing period, net billed electricity for payment by the consumer for that billing cycle and net carried over electricity to the next billing period separately.
 - (b) In case the electricity injected exceeds the electricity consumed from licensees supply system during the billing cycle such excess injected electricity shall be carried forward to the next billing cycle as electricity banked and may be utilized in the next billing cycle(s) within the settlement period. In such a case,

- - (c) In case the electricity supplied by the distribution licensee during any billing period exceeds the electricity injected by the Eligible Consumer, the distribution licensee shall raise a bill for net electricity consumption as per applicable tariff of that category after taking into account any electricity credit balance from previous billing period;
 - (d) In case the Eligible Consumer is under the ambit of TOD tariff, the electricity consumption in any time block i. e. peak hours, off peak hours etc. shall be first compensated with the electricity injected in the same time block. Any excess injection over and above the consumption in any other time block in a billing cycle shall be accounted as if the excess injection occurred during non-peak hours;
 - (e) The surplus energy measured in kWh/kVAh shall be utilized to offset the consumption measured in kWh/kVAh and may not be utilized to compensate any other fee and charges imposed by the licensee as per the orders of the Commission;
 - (f) The Monthly Minimum Charges (MMC), if applicable, shall be leviable on total consumption of the consumer of each billing cycle and not on net consumption. A normative power factor of 0.9 shall be considered for conversion of kWh to kVAh, wherever applicable;
 - (g) The distribution licensee shall also take the reading of solar meter for recording total solar power generated by Solar PV system of consumer;

- (h) The distribution licensee in addition to consumer tariff shall be eligible to raise invoice/bills for any other charges as allowed by the Commission;
- (i) In case of any dispute in billing, the consumer can approach the licensee, who will deal the complaint under provisions of Regulations 6.23 to 6.26 of the Supply Code. In case the consumer feels aggrieved by the licensee's disposal of the complaint, the consumer can approach Consumer Grievances Redressal Forum and Electricity, Ombudsman in accordance with JKSERC (Consumer Grievances Redressal Forum, Ombudsman and Consumer Advocacy) Regulations, 2012, as amended from time to time.
- 11.3 The electricity generated from a rooftop solar system shall not exceed 90% of the electricity consumption by the consumer in a settlement period. The excess energy generated in a billing cycle shall be allowed to be carried forward to the next billing cycle up to the end of the settlement period:

Provided that in the event of electricity generated exceeds 90% of the electricity consumed at the end of the settlement period no payment shall be made by the distribution licensee and shall not be carried forward to next settlement period and the same shall be treated as inadvertent injection:

Provided also that at the beginning of each settlement period, cumulative carried over solar electricity injected shall be reset to zero.

11.4 All the rules and regulations applicable to the consumers of the distribution licensee for the applicable category shall also be applicable to the eligible consumer who uses the rooftop solar system.

- 12. Applicability of other charges.66The rooftop solar system under net metering arrangement whether self-owned or third party owned, installed on the premises of eligible consumer, shall be exempted from various provisions of JKSERC (Terms and Conditions for Intra State Open Access) Regulations, 2015, as amended from time to time:

Provided that the Commission may review such exemption from time to time.

- 13. Eligibility to participate under Renewable Energy Certificate (REC) Mechanism.óóThe eligibility for issuance of renewable energy certificate shall be as per the eligibility criteria specified under Central Electricity Regulatory Commission (Terms and Conditions for recognition and issuance of Renewable Energy Certificate for Renewable Energy Generation) Regulations, 2010, as amended from time to time.
- 14. Renewable Purchase Obligation (RPO).óóThe quantum of electricity consumed by eligible consumer, who is not defined as obligated entity, from the rooftop solar system under net metering arrangement shall qualify towards compliance of Renewable Purchase Obligation (RPO) for the distribution licensee.
- 15. *Penalty*.óóIn case of failure to meet the requirements under these regulations for net metering, the solar power generator shall be liable to pay penalty as decided by the Commission from time to time.

16. Termination of agreementóó

- 16.1 The eligible consumer may terminate the agreement at any time by giving 30 days prior written notice to the licensee.
- 16.2 If an eligible consumer breaches any term of the agreement and does not remedy the breach within 30 days of receipt of written notice from the distribution

- - 16.3 Eligible Consumer, upon termination of the agreement, shall disconnect forthwith the photovoltaic system from licenseegs distribution system.
- 17. Power to give directions.óóThe Commission may from time to time issue such directions and orders as considered appropriate for implementation of these regulations.
- 18. Removal of difficulties.óóIf any difficulty arises in giving effect to the provisions of these regulations, the Commission may, by an order, make such provision, not being inconsistent with the Act and these regulations, which appears to the Commission to be necessary for removal of the difficulties.
- 19. Power to relax.óóThe Commission may by general or special order, for reasons to be recorded in writing and after giving an opportunity of hearing to the parties likely to be affected, may relax any of the provisions of these regulations on its own or on an application made before it by an interested person.
- 20. Power to amend.óóThe Commission may from time to time add, vary, alter, suspend, modify, amend or repeal any provisions of these regulations.

Ву	order	of	the	Com	missio	1.							
							(S d	.)				•••••	
											5	Secret	ary,
				J&K	State	Elec	tricity	Re	egulato	orv	Cor	nmiss	sion.

Srinagar.

óóóóóóó

LIST OF ABBREVIATIONS

AC Alternating Current

AT&C Aggregate Technical and Commercial

BHP Brake Horse Power

BIS Bureau of Indian Standards

CB Circuit Breaker

CEA Central Electricity Authority

CT Current Transformer

DC Direct Current

EHT Extra High Tension
EHV Extra High Voltage
FOR Forum of Regulators

GBI Generation Based Incentive

GIS Geographic Information System

GoI Government of India

GoJK Government of Jammu and Kashmir

GPS Geographic Positioning System

GSM Global System for Mobile Communications

GSS Grid Sub-station HT High Tension

IEC International Electro-technical Commission

IEEE Institution of Electrical and Electronics Engineers

JKSERC J&K State Electricity Regulatory Commission

KV Kilo Volt

KVA Kilo Volt Ampere

KW Kilo Watt

KWh Kilo-Watt hour

LT Low Tension

MNRE Ministry of New and Renewable Energy

MPLS Multiprotocol Label Switching

MVA Mega Volt-Ampere

NM Net Meter

O&M Operation and Maintenance

PCU Power Conditioning Unit

PT/VT Potential/Voltage Transformer

RE Renewable Energy

REC Renewable Energy Certificate

RPO Renewable Purchase Obligation

SLDC State Load Despatch Centre

SM Solar Meter

SPV Solar Photo Voltaic

TVM Tri-Vector Meter

References of the Standards

Standard Reference

IS 13779-1999 Standards for single or polyphase electrostatic watt

hour meters

IS 14697 Standards for static transformer operated watt hour

meters and VAR hour meters

IEEE 61000 Equipment standards to control/curtail flicker

IEEE 519 Standards for Limitation for Total Harmonic

Distortion

26 The J&K Govi 666666666666666666666666666666666666	i. Gazette, 15th Oct., 2015/23rd Asv., 1937. [No. 29-2 0666666666666666666666666666666666666				
IEC 61646	Standards for thin film terrestrial photovoltaic (PV) modules-Design qualification and type approval				
IEC 61730	Standard for Photovoltaic (PV) module safety qualification-Part1: Requirement foconstruction Part 2: Requirements for testing				
	IEC 61701 Standards for Salt mist corrosion testing for modules used in coastal corrosive atmosphere				
IEC 60068-2	(1, 2, 14, 30) Standards for power conditioning unit/inverters for efficiency measurement and environment tests				
IEC 60502	Standards for power cables with extruded insulation and their accessories for rated voltages from 1 kV(Um=1.2 KV up to 30 Kv(Um=36 kV)				
IEC 60227	Standards for polyvinyl chloride insulated cables of rated voltages up to and including $450/750\ V$				
IEC 62116	Standards for utility-inter connected photovoltaic inverters-Test procedures of islanding prevention measures.				

óóóóóó

Format for Application for Solar Power Connectivity

To

The Sub-divisional Officer/ Designated Officer Distribution Licensee

[Name of office]
Date: [date]

I/we herewith apply for a solar energy net metering connection at the service connection and for the solar PV plant of which details are given belowóó

- 1. Name of applicant
- 2. Address of applicant
- 3. Service connection number/Consumer ID
- 4. (a) Sanctioned load
 - (b) Contracted load/demand
- 5. Service connection tariff
- 6. Telephone number(s)
- 7. Email ID
- 8. Solar PV plant capacity (kilo Watts)
- 9. Solar grid inverter make and type
- 10. Solar grid inverter has automatic isolation protection (Y/N) ?
- 11. Has a Solar Generation Meter been installed (Y/N) ?
- 12. Expected date of commissioning of solar PV sytem

PV Plant/inverter for standards required under the Regulations.
Name:
Signature:
Net metering Application Acknowledgement
Received an application for a solar energy net metering connection from
Name:
Date :
Service Connection Number/Consumer ID:
Application Registration No. :
Solar Plant Capacity:
Name of Officer:
Signature:
Designation/(Name of Discom)
<u> </u>

13. Details of test certificates of Solar

Annexure-III

Net Metering interconnection agreement

This Agreement is made and entered into at (location)on this (date) day of (month) year between.
The Eligible Consumer, by the name ofhaving premises at (address) as first party.
And
Distribution Licensee (herein after called as Licensee) and reprsented by(designation of office) and having its registered office at (address) as second party of the agreement.
And whereas, the Licensee agrees to provide grid connectivity to the Eligible Consumer for injection of the electricity generated from his SPV plant of capacitykilowatts into the power system of Licensee and as per conditions of this agreement and JKSERC (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015, issued by the Jammu and Kashmir State Electricity Regulatory Commission.
Both the parties hereby agree to as follows :óó

1. Eligibility—

Eligibility for net metering has been specified in the relevant regulations of the Jammu and Kashmir State Electricity Regulatory Commission. Eligible Consumer has to meet the standards and conditions for being integrated into grid/distribution system.

Technical and Interconnection Requirements—

The Eligible Consumer agrees that his solar generation plant and net metering system will conform to the standards and requirements specified in JKSERC (Grid Interactive Rooftop Solar Photo Voltaic Systems based on Net Metering) Regulations, 2015 and in the following regulations and codes as amended from time to time: 66

- i. CEA
 øs (Technical Standards for connectivity of the Distributed Generating Resources)
 Regulations, 2013;
- ii. Central Electricity Authority (Installation and Operation of Meters) Regulation, 2006;
- iii. JKSERC Electricity Regulatory Supply Code 2011.
- 2.2 Eligible Consumer agrees that he has installed or will install, prior to connection of Photovoltaic System to Licensee distribution system, an isolation device (both automatic and inbuilt within inverter and external manual relays) and agrees for the Licensee to have access to and operation of this, if required and for repair and maintenance of the distribution system.
- 2.3 Eligible Consumer agrees that in case of a power outage on Licensees system, photovoltaic system will disconnect/isolate automatically and his plant will not inject power into Licensees distribution system.
- 2.4 All the equipment connected to distribution system shall be compliant with relevant International (IEEE/IEC) or Indian Standards (BIS) and installations of electrical equipment must comply with Central Electricity Authority (Measures of Safety and Electricity Supply) Regulations, 2010.
- 2.5 Eligible Consumer agrees that licensee will specify the interface/interconnection point and metering point.
- 2.6 Eligible Consumer and licensee agree to comply with the relevant CEA & JKSERC Regulations in respect of operation and

- - 2.7 Due to Licensees obligation to maintain a safe and reliable distribution system, Eligible Consumer agrees that if it is determined by the Licensee that Eligible Consumers photovoltaic system either causes damage to and/or produces adverse effects affecting other consumers or Licensees assets, Eligible Consumer will have to disconnect photovoltaic system immediately from the distribution system upon direction from the Licensee and correct the problem at his own expense prior to a reconnection.
 - 2.8 The consumer shall be solely responsible for any accident to human being/animals whatsoever (fatal/non-fatal) that may occur due to back feeding from the solar plant when the grid supply is off. The licensee reserves the right to disconnect the consumer installation at any time in the event of such exigencies to prevent accident or damage to life and property.

3. Clearances and Approvals—

3.1 The Eligible Consumer shall obtain all the necessary approvals and clearances (environmental and grid connection related) before connecting the photovoltaic system to the distribution system.

4. Access and Disconnection—

- 4.1 Licensee shall have access to metering equipment and disconnecting means of the solar photovoltaic system, both automatic and manual, at all times.
- 4.2 In emergency or outage situation, where there is no access to the disconnecting means, both automatic and manual, such as a switch or breaker, Licensee may disconnect service to the premises of the Eligible Consumer.

5. Liabilities—

- 5.1 Eligible Consumer and Licensee shall indemnify each other for damages or adverse effects from either party negligence or intentional misconduct in the connection and operation of photovoltaic system or Licensee distribution system.
- 5.2 Licensee and Eligible Consumer shall not be liable to each other for any loss of profits or revenues, business interruption losses, loss of contract or loss of goodwill, or for indirect, consequential, incidental or special damages, including, but not limited to, punitive or exemplary damages, whether any of the said liability, loss or damages arise in contract, or otherwise:

Provided that in case of any dispute in respect of clause 5.1 and 5.2 above, the decision of the Commission shall be final and binding on both the parties.

- 5.3 Licensee shall not be liable for delivery or realization by Eligible Consumer for any fiscal or other incentive provided by the Central/State Government beyond the scope specified by the Commission in its relevant order.
- 5.4 The Licensee may consider the quantum of electricity generation from the rooftop solar PV system under net metering arrangement towards RPO. (Applicable only in case of Eligible Consumer who is not defined as an Obligated Entity).
- 5.5 The proceeds from CDM benefits shall be retained by the Licensee.

6. Commercial Settlement—

6.1 All the commercial settlement under this agreement shall follow the Net Metering Regulations, 2015 issued by JKSERC.

7. Connection Costs-

7.1 The Eligible Consumer shall bear all costs related to setting up of photovoltaic system including metering and interconnection

8. Termination—

- 8.1 The Eligible Consumer can terminate agreement at any time by providing Licensee with 30 days prior notice.
- 8.2 Licensee has the right to terminate Agreement on 30 days prior written notice, if Eligible Consumer commits breach of any of the term of this Agreement and does not remedy the breach within 30 days of receiving written notice from Licensee of the breach.
- 8.3 Eligible Consumer shall upon termination of this Agreement, disconnect the photovoltaic system from Licensees distribution system in a timely manner and to Licensees satisfaction.

In witr	ness, whereof, Mr	for and on be	ehalf
of	(Eligible Consumer) and M	Irfor and on bo	ehalf
of	(Licensee) sign this agr	eement in two originals.	

Eligible Consumer Distribution Licensee

Name Name

Address Designation

Service Connection No./ Office Address

Consumer ID

όόόόόόό

Inverter Standards—

Harmonics Standards-

Technical and interconnection requirements Parameters

Annexure-IV Annexure-IV	Solution inverter should comply with IEC 61683/IS 61683 for efficiency and measurements and should comply with IECS of 60068-2 (1, 2, 14, 30)/Equivalent BIS Standard for environmental testing.	Inverter should supervise the grid condition continuously and in the event of grid failure (or) under voltage (or) & provided size inverter should be disconnected by the Circuit Breaker/Auto switch provided in the inverter and shall on comply with requirements specified at Regulation 8 of these regulations.	standards——Standards——	As per the standard IEEE 519, the permissible individual harmonics level shall be less than 3% (for both voltages; and current harmonics) and Total Harmonics Distortion (THD) for both voltage and current harmonics of the system \$\frac{9.0}{9.0}\$ shall be less than 5%.	Technical and interconnection requirements Parameters — — — — — — — — — — — — — — — — — — —	Parameter Reference Requirement Requirement $0.00000000000000000000000000000000000$
Inverter Standards—	Inverter should 60068-2 (1, 2, 14, 30)	Inverter should supervis voltage, Solar System should comply with requirements spe	Harmonics Standards—	As per the stand and current harmonics shall be less than 5%.	Technical and interc	Parameter όδοδόδοδοδοδοδοδοδο 1 όδοδοδοδοδοδοδοδοδο Overall conditions of service

No. 29-2] The J&K C	Govt. Gazette, 1 óóóóóóóóóóóó	5th Oct., 2015// óóóóóóóóóóóóó	23rd Asv., 1937. 35
Compliance with Grid Standards as regards the frequency, voltage and protection coordination.	Compliance with the specifications of the meters.	Compliance with safety provisions for electrical installations and apparatus.	The Total Harmonic Distortion (THD) for voltage at operate interconnection point should not exceed 5%. For operate current distortion limits, the Total Demand Distortion (TDD) in terms of ratio of available short operation circuit current to the demand current (ISC/IL) shouldown remain within limits specified for various harmonics operation different TDD values.
 (i) Central Electricity Authority (Grid Standard) Regulations, 2010; (ii) JKSERC Grid Code; and (iii) JKSERC (Distribution Performance Standards) Regulations, 2006. 	Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended from time to time	Central Electricity Authority (Measures of Safety and Electricity Supply) Regulations, 2010	IEEE 519 CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
Overall Grid Standards	Meters	Safety and supply	Harmonic Requirements Harmonic Current


36 óóó	The J&K Govt. 0	Gazette, 15th Oct., 2015/23rc రదరదదదదదదదదదదదద బ్ర	l Asv., 1937. [1 óóóóóó óó óó ô
όδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	Synchronization CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 Synchronization CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Synchronization a grid frequency synchronization device. Every time the generating station is synchronized to the electricity system, it shall not cause voltage fluctuation greater than +/- 5% at point of inter connection.	The voltage operating window should minimize nuisance tripping and should be within operating range of 80% to 110% of the nominal connected voltage. The photovoltaic system must isolate itself from the grid within a clearing time of 2 seconds.	Operation of Photovoltaic system should not cause over yoltage flicker in excess of the limits stated in over a short period of time (10 minutes) should over a short period of time (10 minutes) should
ιόδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	ίδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
όδόδόδοδοδοδοδοδοδοδοδο 1	όδοδοδοδοδοδοδοδοδοδο Synchronization	Voltage	Flicker

over a short period of time (10 minutes) should $\overset{\circ}{\circ}_{\overset{\hookrightarrow}{\circ}}_{\overset{\hookrightarrow}{\circ}}$ be <=1. Long-term flicker (Plt) : The flicker severity evaluated $\overset{\circ}{\circ}_{\overset{\hookrightarrow}{\circ}}_{\overset{\hookrightarrow}{\circ}}$

No. 29-2 óóóóóó	2] The J&K Go 6ô 666666666666	ovt. Gazette, 15th (Oct., 2015/23rd A óóóóóó (%óóóóóóó	Asv., 1937. 37 óóóóóóóóó ô ô
over a long period of time (typically 2 hours) should 9.50 be <=0.65.	There should be over and under frequency trip functions with a clearing time of 0.2 seconds, when the Distribution system frequency deviates outside the specified conditions (50.5 Hz on upper	Photovoltaic system should not inject DC power more than 0.5% of full rated output at the interconnection point or 1% of rated inverter output current into distribution system under any operating conditions.	When the output of the inverter is greater than 50%, the power output from the inverter shall have a laggi power factor of greater than 0.9.	The photovoltaic system must island/disconnect itself within IEC standard stipulated time in the event of fault, voltage or frequency variations.
	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 side and 47.5 Hz on lower side).	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013
	Frequency	DC Injection	Power Factor	Islanding and Disconnection

óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó	ύδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όσο σο σ
Ī	7	•
όδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	Σοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όδο δο δ
Overload and Overheat	CEA (Technical Standards for Connectivity of the Distributed	The inverter should have the facility to automatically switch off in case of overload
	Generation Resources) Regulations, 2013	or overheating and should restart when normal conditions are restored.
Paralleling Device	CEA (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013	Paralleling device of photovoltaic system shall be capable of withstanding 220% of the normal voltage at the interconnection point.

Schematic Arrangement for interconnection of Rooftop and Small PV Solar Power Plant with the Distribution Licensee's/Grid

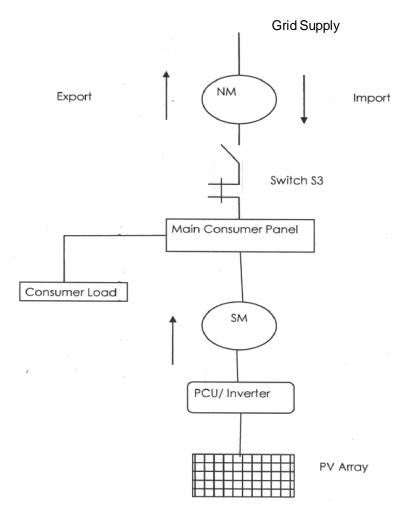

Normally, Solar Generation shall be connected with Grid. When grid fails, Inverter controlled Switch S3 Opens and on restoration of grid S3 Closes.

Abbreviations:


NM: Net Meter, SM: Solar Meter, PCU: Power Conditioning Unit.

óóóóóóó


Annexure-VI

Net Metering configuration options

(1) Two meter configuration without storage

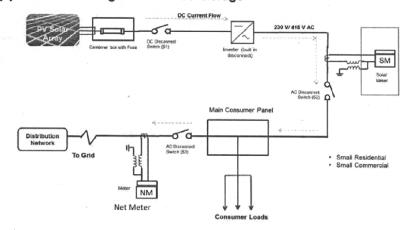

(2) Two meter configuration with storage

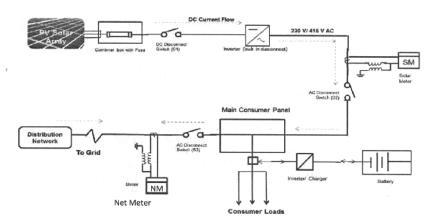

Annexure-VII

Specification for meters for net metering:

(a) Meter for Solar Generation Measurements:

Solar Meter Major Technical Parameters

όδόδό 1 όδόδό 5.	όδο δο δ	ίδοδοδοδοδοδοδοδο 3 Ιδοδοδοδοδοδοδοδοδο 10-60	ίδδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	δόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	όδοδοδοδοδοδοδοδοδο 5 δοδοδοδοδοδοδοδοδοδ
9	Accuracy Class	1.0	1.0	0.5S	0.5S
7.	Indian Standard or IEC to IS 13779-1999 which conforming	IS 13779-1999	IS 13779-1999	IS 14697, IS 13779	IS 14697, IS 13779
∞.	Import-export feature	Forward import	Forward import	Forward import	Forward import
9.	Communication Port/Protocol	Optical/DLMS	Optical, RS-232/DLMS	Optical, RS-232/ DLMS	Optical, RS-232/ DLMS
(b)	Meter for Net Metering Measurements:	surements:			
	Net Meter Major Technical Parameters	arameters			
S. S.	Technical Parameters	Connectivity	Connectivity at 415 V and below voltage level	voltage level	Connectivity at above 415 V voltage level
óóóóć	όδόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	λόδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδο	ύδόδοδοδοδοδοδοδοδο meters	δόδοδοδοδοδοδοδοδοδοδο CT operated	όδοδοδοδοδοδοδοδο CT-PT Operated
óóóóć 1	000000000000000000000000000000000000	3 3 3 3	Σ οδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	\$6666666666666666666666666666666666666	\delta \d

HT/EHV supply

and up to 100 kW contract demand

and up to 15 kW connected load

Up to 5 kW connected load

Applicability

Above 5 kW

Above 15kW

No. 29-2] óóóóóóóô	The J&K Govt. Gazette, 15th Oct., 2015/23rd Asv., 1937. 666666666666666666666666666666666666	43 ô ô
5		

.5	Number of phases and wires	Single Phase, 2 Wire	Three Phase, 4 Wire	Three Phase, 4 Wire	Three Phase, 4 Wire
33	Measurand(s)	kWh	kWh	kWh, kVAh, kVA, PF	kWh, kVAh, kVA, PF, Max. demand
4.	Standard Voltage and frequency	240 V	3x240 V (P-N), 415 V (P-P) 50±5%	3x240 V (P-N), 415 V (P-P) 50±5%	3x63.5 V (P-N), 110 V (P-P) 50±5%
5.	Current Rating	10-60	10-60	1 Amp	1 Amp
9.	Accuracy Class	1.0	1.0	0.58	0.58
7.	Indian Standard or IEC to IS 13779-1999 which conforming	IS 13779-1999	IS 13779-1999	IS 14697, IS 13779	IS 14697, IS 13779
∞.	Import-export feature	Forward import	Forward import	Forward import	Forward import
.6	Communication Port/Protocol	Optical/DLMS	Optical, RS-232/DLMS	Optical, RS-232/ DLMS	Optical, RS-232/ DLMS



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Wed., the 7th Oct., 2015/15th Asv., 1937. [No. 27-k

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóLABOUR AND EMPLOYMENT DEPARTMENT

Notification

Srinagar, the 7th October, 2015.

SRO-355.óóIn exercise of the powers conferred by sub-section (3) of section 18 of the Building and Other Construction Workers (Regulation of Employment and Conditions of Service) Act, 1996 (27 of 1996), the Government of Jammu and Kashmir hereby appoint the following persons

1. Honøble Minister, Labour and Employment, Chairperson J&K.

Central Government Nominee

 Welfare Commissioner (HQ), Ministry of Labour and Employment, Govt. of India, New Delhi.

Members representing the State Government

3. Administrative Secretary to Government, Member Finance Department.

4. Administrative Secretary to Government, Member Labour and Employment Department.

5. Labour Commissioner/Chief Inspector Member of Inspections under Building and Other Construction Workers (RE & ES)
Act, 1996,

6. Special Secretary to Government, Member Social Welfare Department

7. Additional Secretary to Government, Member Department of Law, Justice and Parliamentary Affairs.

Members representing Employers/Principal Employers

8. Secretary (Technical), Power Development Member Department.

9. Special Secretary to Government, Tourism Member Department

10. Chief Engineer PWD (R&B), Jammu. Member

11. Special Secretary to Government, Member Housing and Urban Development Department.

12. Joint Director (Planning), Rural Member Development Department.

By order of the Government of Jammu and Kashmir.

(Sd.) SHAILENDRA KUMAR, IAS,

Commissioner/Secretary to Government, Labour and Employment Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATÓ ÓREVENUE DEPARTMENT

Notification

Srinagar, the 7th October, 2015.

SRO-356.66In exercise of the powers conferred by sub-rule (1) of Rule 14 read with Rule 18 of the Jammu and Kashmir Lambardari Rules, 1980, and in supersession of Notification SRO-407 of 2014 dated 14th of October, 2014, the Government hereby appoint Deputy Commissioner, Kupwara, Shri Kumar Rajeev Ranjan, as the Returning Officer for the purpose of holding the Election of Lambardar of Village Bicherwari, Tehsil Handwara of District Kupwara.

By order of the Government of Jammu and Kashmir.

(Sd.) MUHAMMAD AFZAL, IAS,

Secretary to Government, Revenue Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 8th Oct., 2015/16th Asv., 1937. [No. 28-a

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 8th October, 2015.

SRO-357.66In exercise of the powers conferred by section 5 of the Jammu and Kashmir Levy of Tolls Act, Samvat 1995, the Government hereby exempt from payment of levy of toll, leviable under the said Act,

the items shown in Annexure to this notification, to be imported into the State by the Chief Patron and Executive Director, -Karuna Social Entrepreneurship Foundationø, New Delhi for organizing a panel discussion regarding õSave The Dal and a sufi music show at Botanical Garden on 8th to 10th October, 2015ö subject to condition that the authorized officer of the said organization undertakes that equipments/items are exclusively meant for the aforesaid use only and shall be returned after completion of the event.

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.

óóóóóóó

S. No.	Equipments/items
1.	Sounds
2.	Lights
3.	Table
4.	Chairs
5.	Trussing
6.	Carpet
7.	Console
8.	Fabrication Material
9.	Wood
10.	Black Masking Cloth
11.	Kitchen Items
12.	Cabling
13.	Decor Items

(Sd.) BHARAT SINGH, KAS,

Additional Secretary to Government, Finance Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Thu., the 8th Oct., 2015/16th Asv., 1937. [No. 28-b

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 8th October, 2015.

SRO-358.óóIn exercise of the powers conferred by sub-section (2) of section 3 of the Jammu and Kashmir Entry Tax on Goods Act, 2000, (Act No. IV of 2000), the Government hereby exempt from payment of

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.

óóóóóóó

	quipments/items óóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóóó
2.	Lights
3.	Table
4.	Chairs
5.	Trussing
6.	Carpet
7.	Console
8.	Fabrication Material
9.	Wood
10.	Black Masking Cloth
11.	Kitchen Items
12.	Cabling
13.	Decor Items

(Sd.) BHARAT SINGH, KAS,

Additional Secretary to Government, Finance Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIAT66HEALTH AND MEDICAL EDUCATION DEPARTMENT

Notification

Srinagar, the 8th of October, 2015.

SRO-360.66In exercise of the powers conferred by section 36 of the Dentist Act, 1948 (Central Act of XVI of 1948) read with Rule 49-A of the Jammu and Kashmir State Dental Council Rules, 2004, the Government hereby directs that the Jammu and Kashmir State Dental Council shall maintain a Register of Dental Hygienists/Dental Mechanics under the provisions of the said Act/Rules.

By order of the Government of Jammu and Kashmir.

(Sd.) DR. M. K. BHANDARI, IAS,

Secretary to Government, Health and Medical Education Department.



THE

JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Fri., the 9th Oct., 2015/17th Asv., 1937. [No. 28-e

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIAT66CONSUMER AFFAIRS AND PUBLIC DISTRIBUTION DEPARTMENT

Notification

Srinagar, the 9th of October, 2015.

SRO-361.óóIn exercise of the powers conferred by section 4 of the Jammu and Kashmir Consumer Protection Act, 1987, read with rule 3 of the Jammu and Kashmir Consumer Protection Rules,1987 and in

Choudhary Zulfiqar Ali, Chairman
 Honøble Minister, Consumer Affairs and
 Public Distribution Department and
 Tribal Affairs Department

Shri Saurabh Bhagat, IAS, Member-Secretary
 Secretary to Government,
 Consumer Affairs and
 Public Distribution Department

Member of Legislative Assembly:

 Shri Javaid Beigh, Member Hon
øble MLA

Member of Legislative Council:

 Shri Javaid Mirchal, Member Hon
 ble MLC

2. Shri Yuvraj Vikramditya Singh, Member Honøble MLC

Representatives of Autonomous Organization:

 Shri Karpal Dev Sharma, Member President, Akhar Bhartia Ghrak Panchayat

2. Shri Om Khajuria, Member Ex-Corporator

3. Shri Manish Gupta Member

No. 28-e1	The J&K Govt. Gazette, 9th Oct., 2015/17th Asv., 1937.		3
111111		^	^
00000000	οδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδοδ	$^{\circ}$	$^{\circ}$

Representatives of Consumer Organization/Consumers:

1. Shri D. R. Danish, Member

President, Consumer Prot. Organization

2. Shri Vikram Gaur, Member

President, Consumer Welfare Org., Jammu

3. Shri Manzoor Hussain Shah, Member

Advocate Rajouri

4. Shri Mushtaq Ahmad Daryal Member

President Jamia Masjid Traders

Association, Jammu

Representatives of Women:

1. Smt. Shanti Devi, Member

Honøble Ex. MLA

2. Smt. Seema Shakhar Khajuria, Member

Advocate Jammu

Representatives of Trade and Industrialists:

1. Shri Sheikh Ashaq, Member

President, KCCI

2. Shri Yashpal Gupta, Member

President, Retailers Association,

Jammu

3. Shri Rakesh Gupta, Member

President, Chamber of Commerce and

Industry, Jammu

Persons capable to represent consumer interests not specified above :

1. Shri Bashir Ahmad Mir, Member

Kangan

2. Shri Nazir Yatto, Member

Charar Sharief

3. Shri Bharat Kumar Member

S/o Shri Ashok Kumar, H. No. 201/3, Channi,

Jammu

By order of the Government of Jammu and Kashmir.

(Sd.) SAURABH BHAGAT, IAS,

Secretary to Government, CA & PD Department.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóDEPARTMENT OF LAW, JUSTICE AND PARLIAMENTARY AFFAIRS (Judicial Administration Section)

Notification

Srinagar, the 10th of October, 2015.

SRO-362.óóIn exercise of the powers conferred by sub-section (1) of section 492 of the Code of Criminal Procedure, Samvat 1989, and in partial modification of notification SRO-181 dated 17-06-2015, the Government hereby appoint Chief Prosecuting Officer, Sopore as Special Public Prosecutor for conduct of cases before the Court of Additional District and Sessions Judge, Sopore till further orders.

By order of the Government of Jammu and Kashmir.

(Sd.) MOHAMMAD ASHRAF MIR,

Secretary to Government, Department of Law, Justice and Parliamentary Affairs.



JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-g

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóÓDEPARTMENT OF LAW, JUSTICE AND PARLIAMENTARY AFFAIRS

Notification

Srinagar, the 12th October, 2015.

SRO-363.66In exercise of the powers conferred by sub-section (1) of section 12 of the Code of Criminal Procedure, Samvat 1989, the Government hereby appoint the below mentioned officers to be the executive Magistrates of the First Class who shall exercise all the powers of an

S/Shri

- 1. Bashir Ahmad Bhat, Sub-Divisional Magistrate, Sopore;
- 2. Ashiq Hussain Wani, Hq. Assistant to Deputy Commissioner;
- 3. Irfan Bhadur, Tehsildar, Baramulla;
- 4. Bilal Ahmad Najar, Tehsildar, Sopore;
- 5. Sayed Fahim Bihaqi, Tehsildar, Kawarhama;
- 6. Abrar Inayat, Tehsildar Khole;
- 7. Jaffar Hussain Shiekh, Tehsildar, Uri;
- 8. Javid Ahmad Zargar, Tehsildar, Tangmarg;
- 9. Ghulam Nabi Wani, Tehsildar, Wagoora.

By order of the Government of Jammu and Kashmir.

(Sd.) MOHAMMAD ASHRAF MIR,

Secretary to Government, Department of Law, Justice and Parliamentary Affairs.



JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-h

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government-Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 12th October, 2015.

SRO-364.66In exercise of the powers conferred by sub-section (2) of section 3 of the Jammu and Kashmir Entry Tax on Goods Act, 2000, (Act No. IV of 2000), the Government hereby exempt from payment of entry tax, leviable under the said Act, the material which includes, food grains, tents, iron rods, lights, wires, bulbs and other decoration items to be

imported into the State by Bhagwan Shree Lakshmi Narayan Dham, Jammu for holding õPrabhu Kripa Duk Nivaran, Samagamö at Bari Brahmna, District Samba w. e. f. 13th to 19th October, 2015, provided that the Convenors of the said organization undertake that the material so imported into the State are exclusively meant for the aforesaid use only and shall be returned after completion of the event.

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.



THE JAMMU & KASHMIR GOVERNMENT GAZETTE

Vol. 128] Jammu, Mon., the 12th Oct., 2015/20th Asv., 1937. [No. 28-i

Separate paging is given to this part in order that it may be filed as a separate compilation.

PART I—B

Jammu and Kashmir Government—Notifications.

ôôôó

GOVERNMENT OF JAMMU AND KASHMIR CIVIL SECRETARIATóóFINANCE DEPARTMENT

Notification

Srinagar, the 12th October, 2015.

SRO-365.66In exercise of the powers conferred by section 5 of the Jammu and Kashmir Levy of Tolls Act, Samvat 1995 (Act No. VIII of 1995), the Government hereby exempt from payment of levy of tolls, leviable under the said Act, the material which includes, food grains, tents, iron rods, lights, wires, bulbs and other decoration items to be imported into

By order of the Government of Jammu and Kashmir.

(Sd.) NAVIN K. CHOUDHARY, IAS,

Commissioner/Secretary to Government, Finance Department.